

ENERGY AUDIT REPORT

Of

ANIL NEERUKONDA INSTITUTE OF TECHNOLOGY AND SCIENCES

Sangivalasa, Visakhapatnam



By



TÜV INDIA PRIVATE LIMITED
TÜV NORD GROUP

3RD FLOOR, 304 AND 304/A, ASHOKA BHOOPAL CHAMBERS,
SP ROAD, SECUNDERABAD, Hyderabad, Telangana - 500003

June 2022



K. Sankar
HEAD - CERTIFICATIONS

Abulhasan
SYED AHMED MOHIDDIN
ASSESSOR - SUSTAINABILITY



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



ACKNOWLEDGEMENT

TUV India wishes to thank all the staff and Management of *Anil Neerukonda Institute of Technology & Science* management, teaching & non-teaching for the kind cooperation and assistance extended to our Auditors during the course of the Energy Audit.

TUV Audit Team

Manoj Kumar Borekar

Head – Energy | Water | Sustainability

Amitabh Srivastava

In charge – Energy & Water Services

Syed Ahamed Mohiuddin

Assessor – Energy | Water | Sustainability

G. Chandra Kiran

Executive – Certifications

ANITS Team

Dr. R. Satish

Assistant Professor, Department of Electrical and Electronic Engineering

Dr. S. Siva Kumar

Assistant Professor, Department of Chemistry

P.V.R Sravya

Assistant Professor, Department of Civil Engineering



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



Table of Contents

1. EXECUTIVE SUMMARY	4
2. PROJECT BACKGROUND:.....	5
3. ENERGY SCENARIO AT ANITS.....	6
3.1 ELECTRICITY FROM GRID	7
3.2 SOLAR ENERGY	11
3.3 FUEL CONSUMPTION	19
4.0 WATER CONSUMPTION SCENARIO AT ANITS	34
5.0 REFERENCE STANDARDS & REGULATIONS.....	37



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



1. EXECUTIVE SUMMARY

Energy Audit of Anil Neerukonda Institute of Technology & Sciences was carried out by TUV India during June 2022. The approach taken in this facility included different tools such as preparation of questionnaire, physical inspection of the campus, observation and review of the documentation, interviewing key persons and associated systems & monitoring equipment, including the electrical, lighting & HVAC systems, water management and operational & maintenance procedures. The study covered the following areas to summarize the present status of environment management in the campus:

- Energy management
- Water management

The report accounts for the energy consumption, water consumption and management measures of the *Anil Neerukonda Institute of Technology & Sciences* based on actual assessment. The report compiles a list of possible actions to conserve and efficiently access the available scarce resources and their saving potential is also identified.





Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



2. PROJECT BACKGROUND:

2.1 Objective

The scope of work includes gap analysis of the college campus as per applicable regulations and standards relating to electricity consumption, water consumption, and safety practices.

2.2 Methodology

The Study team having diversified experience in Energy Audits, Water Audits, Green Audit, ISO 14001, ISO 45001, ISO 14064, ISO 50001, GRI reporting, AA1000AS, GHG Accounting and Sustainability validations/ Verifications along local EHS legislations is identified and formed to conduct the study.

The team verified all applicable environmental aspects as per the GRI (Global Reporting Initiative) Sustainability Reporting Standards for the entire campus including the EHS (Environment and Health Safety) safety requirements to evaluate institution's intent towards the Sustainability and EHS safety in combating climate change as well as their role towards carbon neutrality, GHG mitigation measures, communications to stakeholder and their concerns.

2.3 About TÜV India

TÜV India Private Limited was incorporated in India in the Year 1989 and is a premier organization in the field of Testing, Certification, Inspection and Training. The company is a subsidiary of TÜV Nord group, which has been working for last 150 Years in the field of Quality, Safety, Health, Standardization, Certification, and Inspection. It has presence in over 70 countries and offers expert services through a global network. With more than 15000 professionals worldwide TÜV Nord has a turnover of over 1 billion Euros. TÜV India offers entire range of services in certification and inspection in India and South Asia with our contingent of professionally qualified and industry experienced Auditors and Inspectors. With a strong team of qualified Engineers having diversified experience in the field of Building Construction, Maintenance, quality assurance, examination of Buildings in distress and related rehabilitation works. We at TÜV ensure to optimize customer operational efficiencies and thereby maximize customer satisfaction.

2.4 About the Institution



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



ANIL NEERUKONDA INSTITUTE OF TECHNOLOGY AND SCIENCES (ANITS), was established in the academic Year 2001-02 with the approval of the *ALL INDIA COUNCIL FOR TECHNOLOGY EDUCATION (AICTE)*, New Delhi and the Government of Andhra Pradesh and is affiliated to *ANDHRA UNIVERSITY (AU)*, Visakhapatnam.

"ANITS" is located in a plot of 12 acres' area in Sangivalasa Village of Bheemunipatnam Mandalam and is approximately 300 meters from the Chennai - Kolkata Highway.

The campus has a population of around 4,766 of which, 4636 are only day users. Of the total population, 92.02% are Students, while teaching and supporting staff account for 5.24 % and 2.72 %, respectively.

ANITS - Campus Population



■ Students ■ Teaching Staff ■ Non Teaching Staff

Infrastructure:

The college campus is spread over an area of over 12 Acres with amenities like Central library, Class Rooms & Seminar Halls, Transport, Hostels for Boys & Girls, Cafeteria, Medical and Sports.

3. ENERGY SCENARIO AT ANITS

The energy consumption in *ANIL NEERUKONDA INSTITUTE OF TECHNOLOGY AND SCIENCES (ANITS)* campus includes three types of energy sources:



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



- (1) Electricity from the Public supply – Eastern Power Distribution Company Limited – A.P
- (2) Electricity from the Own Solar plant
- (3) Diesel (HSD)

The Institute during the audit year has consumed 2274/day units with a mean of 69,192 units per month. However, the monthly variations were very high and ranged from a low of 48948 units in January to a high of 94176 units in November. From November to February, the consumption decreased gradually, despite the fact that the period may have peak academic activity. The declined power consumption from November to January indicates could be due to reduced use of Air conditioners.

The Institution has a total of split air conditioners together have a cooling capacity of 500 tons. The illumination and air circulation in the facilities needed examination.

On the whole, the per capita electricity consumption in the institute is around 174 units/annum, which is reasonably good in Educational Institutions.

Considering the monthly consumption data, it has been recorded that 830311 units of electricity has been consumed by the institute among which it is observed that November month has utilized the highest amount of Electric energy i.e. 94176 units, and lowest i.e. 48948 units in the month of January.

3.1 ELECTRICITY FROM GRID

The campus has Contacted Maximum Demand (CMD) of 450 KVA from Eastern Power Distribution Limited of Andhra Pradesh State. Main Panel room of 11Kv/440V is situated in the campus and are equipped with all safety measures.



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



Appliances and their power consumption rates in Campus

The campus is equipped with state of the art infrastructure and are listed below,

S. no	Name of appliance	Power Rating(Watt)	Quantity	Power Consumption (Watt)	Average usage per day (hr.)	Power Consumption/day (Watt)
A	B	C	D	E = C X D	F	G = E X F
1	Ceiling fans	80 W	1686	134880	6	809280
2	Pedestal fans	55 W	43	2365	6	14190
3	Tube lights (LED)	20W	1469	29380	6	176280
4	Desktops	50 W	783	39150	6	234900
6	Printers	50 W	67	3350	2	6700
7	AC's	2000 W	332	664000	4	2656000
8	LCD projectors	280 W	116	32480	2	64960



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



9	Wireless routers	6 W	37	222	24	5328
10	Window AC's	1400W	3	4200	4	16800
11	CC camera	10 W	153	1530	24	36720

Electrical Bill Analysis of ANITS Campus

The Energy bill data were analyzed from March 2021 to February 2022, the total electricity bill for the academic year 2021 - 2022 is Rs. 80,48,184 and energy unit consumption is 8,30,311kWh.

Month	Energy Consumption (kWh)	Energy Cost (INR)	Unit Cost/kWh
Mar-21	71696	703821	9.82
Apr-21	66657	558548	8.38
May-21	45978	368212	8.01
Jun-21	48085	463018	9.63
Jul-21	58462	591223	10.11
Aug-21	88154	905666	10.27
Sep-21	87862	910919	10.37
Oct-21	92010	889008	9.66
Nov-21	92958	836470	9.00
Dec-21	64021	661056	10.33
Jan-22	48948	477990	9.77
Feb-22	65480	682253	10.42
Total	830311	8048184	9.69

Table 1: Energy Bill Analysis March 2021 to February 2022



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



MONTHLY ENERGY CONSUMPTION PATTERN

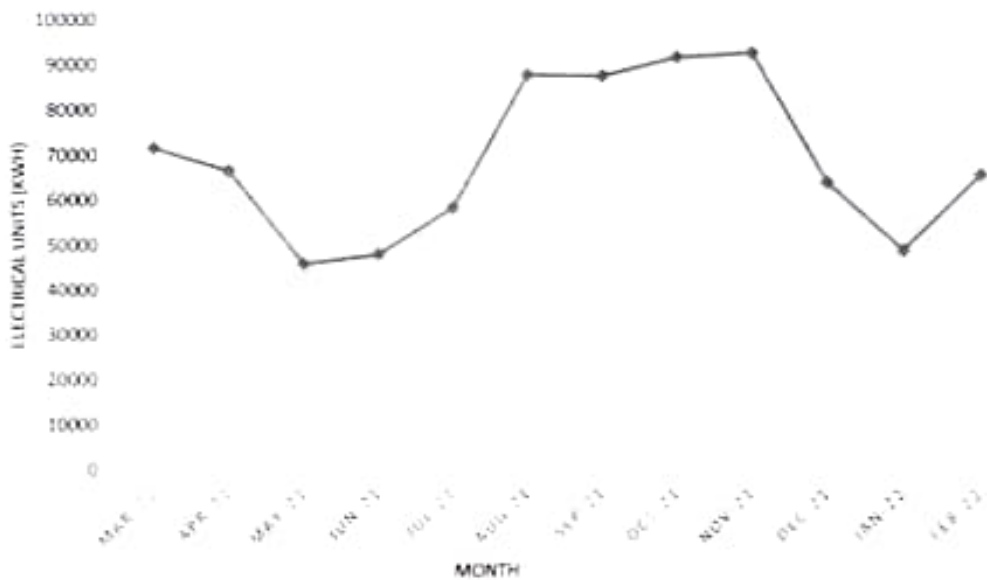


Figure 1: kWh Consumption analysis – During November 2021 energy consumption is high



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



3.2 SOLAR ENERGY

Institute has 450 KVA solar power generation systems with 1364 panels installed and is connected to the grid. Therefore, Energy units consumed from the public supply are exclusive of this power.



The solar panels are installed on the roof top of every department and the power generation details are mentioned in the below table from Jan 2021 to May 2022. The average plant load factor (PLF) of the solar power plant is 8.94 %. The monthly power generation is recorded by the management and the details are presented below,

Location	Residency boys & Girls hostel		Chemical block		CSE block		CSE block		EEE block		G Block		ECE Block			
INVERTERS	System ID	1843	System ID	1910	System ID	1834	System ID	1838	System ID	1928	System ID	1840	System ID	1863	Total	
	KVA	48	KVA	69	KVA	73	KVA	69	KVA	69	KVA	53	KVA	69	KVA	450
	MVA	0.04	MW	0.06	MW	0.07	MW	0.06	MW	0.06	MW	0.09	MW	0.06	MW	0.45
	Act.Units Per Day	8	Act.Units Per Day	9	Act.Units Per Day	3	Act.Units Per Day	9	Act.Units Per Day	9	Act.Units Per Day	3	Act.Units Per Day	9	Act.Units Per Day	1096
Month - Jan 2021	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF
TOTAL	4544	9%	7277	5%	7420	2%	7159	1%	7231	6%	4815	2%	6598	6%	45044	0%

Location	Residency boys & Girls hostel		Chemical block		CSE block		CSE block		EEE block		G-Block		ECE Block			
INVERTERS	System ID	1843	System ID	1910	System ID	1834	System ID	1838	System ID	1928	System ID	1840	System ID	1863	Total	
	KVA	48	KVA	69	KVA	73	KVA	69	KVA	69	KVA	53	KVA	69	KVA	450
	MVA	0.04	MW	0.06	MW	0.07	MW	0.06	MW	0.06	MW	0.09	MW	0.06	MW	0.45
	Act.Units Per Day	8	Act.Units Per Day	9	Act.Units Per Day	3	Act.Units Per Day	9	Act.Units Per Day	9	Act.Units Per Day	3	Act.Units Per Day	9	Act.Units Per Day	1096
Month - Feb 2021	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF
TOTAL	4689	6%	7341	2%	7504	6%	1130	%	6269	2%	4900	7%	6873	7%	38702	7%

Location	Residency boys & Girls hostel		Chemical block		CSE block		CSE block		EEE block		G-Block		ECE Block			
INVERTERS	System ID	1843	System ID	1910	System ID	1834	System ID	1838	System ID	1928	System ID	1840	System ID	1863	Total	
	KVA	48	KVA	69	KVA	73	KVA	69	KVA	69	KVA	53	KVA	69	KVA	450
	MVA	0.04	MW	0.06	MW	0.07	MW	0.06	MW	0.06	MW	0.09	MW	0.06	MW	0.45
	Act.Units Per Day	8	Act.Units Per Day	9	Act.Units Per Day	3	Act.Units Per Day	9	Act.Units Per Day	9	Act.Units Per Day	3	Act.Units Per Day	9	Act.Units Per Day	1096
Month - Mar 2021	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF
TOTAL	4557	9%	7963	2%	7239	7%	6748	8%	6986	6%	4735	1%	6807	0%	40056	6%

Location	Residency boys & Girls hostel		Chemical block		CSE block		CSE block		EEE block		G-Block		ECE Block			
----------	-------------------------------	--	----------------	--	-----------	--	-----------	--	-----------	--	---------	--	-----------	--	--	--



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



INVERTERS	System ID	1843	System ID	1910	System ID	1834	System ID	1818	System ID	1928	System ID	1840	System ID	1861	Total	
	KVA	48	KVA	69	KVA	73	KVA	69	KVA	69	KVA	53	KVA	69	KVA	450
	MVA	0.04	MVA	0.06	MVA	0.07	MVA	0.06	MVA	0.06	MVA	0.05	MVA	0.06	MVA	0.45
	Act.Units Per Day	8	Act.Units Per Day	9	Act.Units Per Day	3	Act.Units Per Day	9	Act.Units Per Day	9	Act.Units Per Day	1	Act.Units Per Day	9	Act.Units Per Day	1080
Month - Apr 2021	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF
TOTAL	5360	%	8416	%	8409	%	5859	%	3188	%	6002	%	7697	%	45111	%

Location	Residency boys & Girls hostel,	Chemical block	CSE block	CSE block	EEE block	G-Block	ECE Block	Total								
INVERTERS	System ID	1843	System ID	1910	System ID	1834	System ID	1818	System ID	1928	System ID	1840	System ID	1861	KVA	450
	KVA	48	KVA	69	KVA	73	KVA	69	KVA	69	KVA	53	KVA	69	KVA	0.45
	MVA	0.04	MVA	0.06	MVA	0.07	MVA	0.06	MVA	0.06	MVA	0.05	MVA	0.06	MVA	1080
	Act.Units Per Day	8	Act.Units Per Day	9	Act.Units Per Day	3	Act.Units Per Day	9	Act.Units Per Day	9	Act.Units Per Day	1	Act.Units Per Day	9	Act.Units Per Day	0
Month - May 2021	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF
TOTAL	3446	6%	8633	8%	3011	4%	8725	6%	219	4%	5987	6%	8570	5%	46541	6%

Location	Residency boys & Girls hostel,	Chemical block	CSE block	CSE block	EEE block	G-Block	ECE Block	Total								
INVERTERS	System ID	1843	System ID	1910	System ID	1834	System ID	1818	System ID	1928	System ID	1840	System ID	1861	KVA	450
	KVA	48	KVA	69	KVA	73	KVA	69	KVA	69	KVA	53	KVA	69	KVA	0.45
	MVA	0.04	MVA	0.06	MVA	0.07	MVA	0.06	MVA	0.06	MVA	0.05	MVA	0.06	MVA	1080
	Act.Units Per Day	8	Act.Units Per Day	9	Act.Units Per Day	3	Act.Units Per Day	9	Act.Units Per Day	9	Act.Units Per Day	1	Act.Units Per Day	9	Act.Units Per Day	0
Month - Jun 2021	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



TOTAL	488	14.6	788	15.3	7930	14.8	7337	15.2	12	0.02	4995	13.5	7182	14.9	29327	11.5
		3%		9%		7%		4%		%		4%		6%		3%

Location	Residency boys & Girls hostel	Chemical block	CSE block	CSE block	EEE block	G-Block	ECE Block							
INVERTERS	System ID 1843	System ID 1910	System ID 1834	System ID 1838	System ID 1928	System ID 1840	System ID 1863	Total						
	KVA 48	KVA 69	KVA 73	KVA 69	KVA 69	KVA 53	KVA 69	KVA	450					
	MVA 0.04	MVA 0.06	MVA 0.07	MVA 0.06	MVA 0.06	MVA 0.05	MVA 0.06	MVA	0.45					
	Act. Units Per Day 1152	Act. Units Per Day 1656	Act. Units Per Day 1752	Act. Units Per Day 1656	Act. Units Per Day 1656	Act. Units Per Day 1272	Act. Units Per Day 1656	Act. Units Per Day	1080					
Month - Jul 2021	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units	PLF					
TOTAL	4900	14.4	7177	14.8	7807	15.2	0.00	5184	13.5	7.83	26821	6%		

Location	Residency boys & Girls hostel	Chemical block	CSE block	CSE block	EEE block	G-Block	ECE Block							
INVERTERS	System ID 1843	System ID 1910	System ID 1834	System ID 1838	System ID 1928	System ID 1840	System ID 1863	Total						
	KVA 48	KVA 69	KVA 73	KVA 69	KVA 69	KVA 53	KVA 69	KVA	450					
	MVA 0.04	MVA 0.06	MVA 0.07	MVA 0.06	MVA 0.06	MVA 0.05	MVA 0.06	MVA	0.45					
	Act. Units Per Day 1152	Act. Units Per Day 1656	Act. Units Per Day 1752	Act. Units Per Day 1656	Act. Units Per Day 1656	Act. Units Per Day 1272	Act. Units Per Day 1656	Act. Units Per Day	1080					
Month - Aug 2021	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units	PLF					
TOTAL	5140	14	7608	14.8	7793	15	0	5302	13.8	0.93	22846	6%		

Location	Residency boys & Girls hostel	Chemical block	CSE block	CSE block	EEE block	G-Block	ECE Block		
INVERTERS	System ID 1843	System ID 1910	System ID 1834	System ID 1838	System ID 1928	System ID 1840	System ID 1863	Total	
	KVA 48	KVA 69	KVA 73	KVA 69	KVA 69	KVA 53	KVA 69	KVA	450



Energy Audit Report

ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE
Sangivalasa, Visakhapatnam



	MVA		MW		MW		MW		MW		MW		MW		MW	
	0.04	0	0.06	0	0.07	0	0.06	0	0.06	0	0.06	0	0.06	0	0.06	0
	Act. Units	Per Day	Act. Units	Per Day	Act. Units	Per Day	Act. Units	Per Day	Act. Units	Per Day	Act. Units	Per Day	Act. Units	Per Day	Act. Units	Per Day
Month - Sept 2021	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF
TOTAL	4771	%	7336	%	7440	%	7206	%	0	%	4959	%	0	%	31801	%

Location	Residency boys & Girls hostel		Chemical block		CSE block		CSE block		EEE block		G-Block		ECE Block			
INVERTERS	System ID	1843	System ID	1930	System ID	1834	System ID	1838	System ID	1928	System ID	1840	System ID	1803	Total	
	KVA	48	KVA	55	KVA	72	KVA	60	KVA	55	KVA	53	KVA	55	KVA	403
	MVA	0.04	MVA	0.06	MVA	0.07	MVA	0.06	MVA	0.06	MVA	0.04	MVA	0.04	MVA	0.35
	Act. Units	1152	Act. Units	1656	Act. Units	1752	Act. Units	1656	Act. Units	1656	Act. Units	1272	Act. Units	1656	Act. Units	1080
Month - Oct 2021	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF
TOTAL	5208	8%	7079	4%	7503	5%	7626	0%	1368	%	5301	7%	2576	%	37029	8%

Location	Residency boys & Girls hostel		Chemical block		CSE block		CSE block		EEE block		G-Block		ECE Block			
INVERTERS	System ID	1843	System ID	1930	System ID	1834	System ID	1838	System ID	1928	System ID	1840	System ID	1803	Total	
	KVA	48	KVA	55	KVA	72	KVA	60	KVA	55	KVA	53	KVA	55	KVA	403
	MVA	0.04	MVA	0.06	MVA	0.07	MVA	0.06	MVA	0.06	MVA	0.05	MVA	0.04	MVA	0.35
	Act. Units	1152	Act. Units	1656	Act. Units	1752	Act. Units	1656	Act. Units	1656	Act. Units	1272	Act. Units	1656	Act. Units	1080
Month - Nov 2021	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF
TOTAL	4029	8%	4879	%	6876	5%	6263	4%	0	%	4224	5%	0	%	25289	%



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



Location	Residency boys & Girls hostel,	Chemical block	CSE block	CSE block	EEE block	G-Block	ECE Block		
INVERTERS	System ID 1843	System ID 1910	System ID 1834	System ID 1838	System ID 1928	System ID 1840	System ID 1843	Total	
	KVA 48	KVA 69	KVA 73	KVA 69	KVA 69	KVA 53	KVA 69	KVA	450
	0.06	0.06	0.07	0.06	0.06	0.05	0.06	MVA	0.45
	8	9	3	9	9	3	9	Act. Units Per Day	1090
Month - Dec 2021	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF
TOTAL	4830	5752	7384	7299	0	4901	1854	32820	1.42

Location	Residency boys & Girls hostel,	Chemical block	CSE block	CSE block	EEE block	G-Block	ECE Block		
INVERTERS	System ID 1843	System ID 1910	System ID 1834	System ID 1838	System ID 1928	System ID 1840	System ID 1843	Total	
	KVA 48	KVA 69	KVA 73	KVA 69	KVA 69	KVA 53	KVA 69	KVA	450
	0.04	0.06	0.07	0.06	0.06	0.05	0.06	MVA	0.45
	8	9	3	9	9	3	9	Act. Units Per Day	1090
Month - Jan 2022	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF
TOTAL	5552	7367	8426	8264	0	5556	0	35183	5%

Location	Residency boys & Girls hostel,	Chemical block	CSE block	CSE block	EEE block	G-Block	ECE Block		
INVERTERS	System ID 1843	System ID 1910	System ID 1834	System ID 1838	System ID 1928	System ID 1840	System ID 1843	Total	
	KVA 48	KVA 69	KVA 73	KVA 69	KVA 69	KVA 53	KVA 69	KVA	450
	0.04	0.06	0.07	0.06	0.06	0.05	0.06	MVA	0.45
	8	9	3	9	9	3	9	Act. Units Per Day	1090
Month - Dec 2021	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF
TOTAL	1112	1656	1752	1656	1656	1272	1656	3880	0



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



Month - Feb	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF
2022		15.9		14.3		14.3		1.45		7.22		14.7		0.74		11.8
TOTAL	4959	4%	7329	9%	7732	9%	1830	%	8234	%	5077	8%	1907	%	3387	1%

Location	Residency boys & Girls hostel	Chemical block	CSE block	CSE block	EEE block	G-Block	ECE Block	
INVERTERS	System ID 1843	System ID 1910	System ID 1834	System ID 1838	System ID 1928	System ID 1840	System ID 1863	Total
	KVA 48	KVA 69	KVA 73	KVA 89	KVA 69	KVA 53	KVA 69	KVA 450
	0.04	0.06	0.07	0.06	0.06	0.05	0.06	
	8	9	3	9	9	8	9	0.45
Act.Units Per Day 1152	Act.Units Per Day 1654	Act.Units Per Day 1752	Act.Units Per Day 1616	Act.Units Per Day 1654	Act.Units Per Day 1272	Act.Units Per Day 1856	Act.Units Per Day 1080	0
Month - Mar 2022	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF
TOTAL	4587 9%	7063 2%	7229 7%	6748 8%	6886 6%	4735 1%	6867 6%	40058 8%

Location	Residency boys & Girls hostel	Chemical block	CSE block	CSE block	EEE block	G-Block	ECE Block	
INVERTERS	System ID 1843	System ID 1910	System ID 1834	System ID 1838	System ID 1928	System ID 1840	System ID 1863	Total
	KVA 48	KVA 69	KVA 73	KVA 89	KVA 69	KVA 53	KVA 69	KVA 450
	0.04	0.06	0.07	0.06	0.06	0.05	0.06	
	8	9	3	9	9	8	9	0.45
Act.Units Per Day 1152	Act.Units Per Day 1656	Act.Units Per Day 1752	Act.Units Per Day 1616	Act.Units Per Day 1654	Act.Units Per Day 1272	Act.Units Per Day 1856	Act.Units Per Day 1080	0
Month - Apr 2022	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF	Units PLF
TOTAL	5360 1.02	8418 1.11	8609 1.07	5858 0.77	3168 0.42	6002 1.03	7697 1.01	45111 0.91

Location	Residency boys & Girls hostel	Chemical block	CSE block	CSE block	EEE block	G-Block	ECE Block	
INVERTERS	System ID 1843	System ID 1910	System ID 1834	System ID 1838	System ID 1928	System ID 1840	System ID 1863	Total



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



	KVA	48	KVA	69	KVA	73	KVA	69	KVA	69	KVA	52	KVA	69	KVA	100
	MVA	0.04	MVA	0.06	MVA	0.07	MVA	0.06	MVA	0.06	MVA	0.05	MVA	0.06	MVA	0.05
	Act Units Per Day	8	Act Units Per Day	9	Act Units Per Day	1	Act Units Per Day	8	Act Units Per Day	9	Act Units Per Day	1	Act Units Per Day	5	Act Units Per Day	1000
Month - May 2022	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF	Units	PLF
TOTAL	5446	8%	8633	8%	9011	4%	8725	6%	218	1%	1937	6%	8570	5%	48541	6%

The technical description and capacity of solar power plant is presented below,

Solar Panels								
#	PANEL INFO	EEE	ECE	CSE	CHEMICAL	MECH	IT	GIRLS HOSTEL
1	COMPANY	ORB Energy	ORB Energy	ORB Energy	ORB Energy	ORB Energy	ORB Energy	ORB Energy
2	INVERTER	Schneider	Schneider	Schneider	Schneider	Schneider	Schneider	Schneider
3	Modules	209	209	209	209	220	160	148
4	POWER	330Wp	330Wp	330Wp	330 Wp	320 Wp	330 kWp	330 kWp
5	TOTALPOWER(KWP)	68.97kW	68.97	68.97	68.97 kWP	72.6 kWP	52.8 kWP	48.84 kWp
6	INVERTER RATING	66 kVA	66kVA	66kVA	66 kVA	66 kVA	66 kVA	66 kVA
7	INVERTERS	01	01	01	01	01	01	01

3.3 FUEL CONSUMPTION

Diesel fuel is the second major use sector for energy in the Institute. The audit results indicate, the Institute's transportation by buses covers a distance ranging from 28400 km/month to 65822 km/month, with a mean of 44946 km/month. The transportation consumption of Diesel ranges from 6600 liters/month to 15380 liters/month, with a mean of 11483 liters/month. Another 884 liters/month of HSD is consumed by administrative vehicles. Thus, the institution transportation covers around 35% of the campus population.


The remaining 65% attend by various means, like, public transport (16%), private hired transport vehicles mostly 3 wheeler rickshaw (27%) vehicles, and about 8% of the population uses their own vehicles as was revealed from the rapid survey. By maximizing the entropy of the transportation data, it is estimated that all the travel trips of the campus population had a per capita HSD consumption was arrived at 83.82 liters/annum.

ANITS campus also uses LPG fuel for its hostel messes and in some laboratories also. The evidences revealed that the annual consumption of LPG in all the facilities for the year 2021-2022 was 560 kg.

Fuel Consumption in Transportation



Fuel Consumption in DG Set

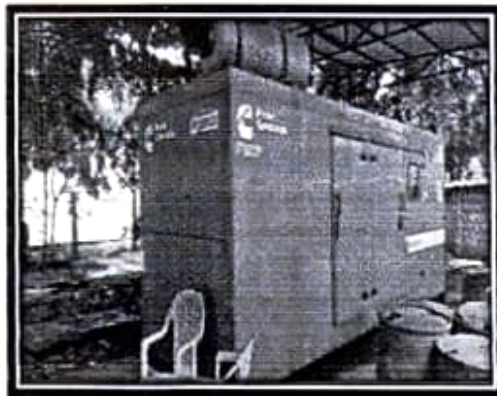



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



Campus infrastructure in various Departments.

#	Name of the Department	Annexure number
1	Computer Science Engineering	Annexure I
2	Mechanical Engineering	Annexure II
3	Electronics & Communication Engineering	Annexure III
4	Chemical Engineering	Annexure IV
5	Electrical & Electronics Engineering	Annexure V
6	Information Technology	Annexure VI
7	Civil Engineering	Annexure VII
8	Administration	Annexure VIII
9	GIRLS HOSTEL (BLOCK A & B)	Annexure IX
10	BOYS HOSTEL (BLOCK A & B)	Annexure X

Annexure I – Computer Science Engineering

S No	Room	Ceiling fans	Pedestal fans	Tube lights	Desktops	UPS	Printers	AC's	LCD projectors	Wireless routers	Window AC's
1	101-CR	5		4					1		
2	102-FC	3		3							
3	103-FC	3		3	1	1					
4	104-CR	5		5					1		
5	105-FC	2		2			1				
6	106-FC	4	2	4		1	1				
7	107-L		1		37				1		3
8	108-FC	2		3	5		1	1			
9	109-SR	1		3				2			
10	110-L		1		36			3			
11	111-L	4		2	15						
12	Lobby			4							
13	201-cabin	4	1	3	2						
14	202-L		1		1	2		3	1		
15	203-FC	2		2	1	1	1	1			



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



16	205-CR	7		5					1	1	
17	206-CR	7		5					1		
18	207-CR	8		8	60	3		4	1		
19	208-L	6		5		2					
20	209-O	3		3	1	1	1				
21	301-LB	4		3							
22	302-L			4				2			
23	303-CR			4	1	1	1	1			
24	304-SR	2		2	2	2					
25	306-CR	7		5					1		
26	307-CR	7		5					1		
27	309-CR	7		5							
28	310-FR	3		2	1	1					
29	311-FR	3		2							
30	312-FR	3		2	1	1					
31	313-CR	7		5					1		
32	401-L	12		10	16	1		3			
33	402-FR	2		2	1	1					
34	403-FR	2		2							
35	404-CR	5		4					1		
36	405-CR	5							1		
37	407-CR	7		5					1		
38	408-L	1			36	1					
39	409-CR	8							1		
40	Lobby	1		3							
41	TOTAL	152	6	129	217	19	6	20	14	1	3

Annexure II - Mechanical Engineering

S No	Room	Ceiling fans	Pedestal fans	Tube lights	Deskt ops	UPS	Printers	AC's	LCD projectors	Wireless routers
1	101-L	16		19						
2	102-FD	5		4					1	
3	103-EC	5		3	2	1	2			
4	103A-FR	1		1						
5	104-FR	2		3	1	1	2	1		
6	105-L	1		6	1			2		
7	105 A-FR	1		1	1	1				
8	106-L	5		4						



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



9	107-L	6		3					
10	108-L	13		10	1				
11	LOBBY			5					
12	201-DH	12		10					
13	202-CR	5		3				1	
14	203-CR	5		4				1	
15	204-CR	5		5					
16	205-CR	5		3					
17	206-CR	6		5				1	
18	207-CR	6		4					
19	208-DH	10		14					
20	LOBBY			5					
21	301-L	5	1	11	70	2	6	1	
22	303-L	2		2					
23	304-FR	1		1	1				
24	305-FR	1		1					
25	306-FR	1		1					
26	307-FR	1		1					
27	308-FR	1		1					
28	309-FR	1		1					
29	310-FR	3		2					
30	311- 311LIBRA RY	3		2	2				
31	312-FR	3		2	1	1			
32	314-FR	4		2					
33	315-CR	5		3				1	
34	317-FR	1		1					
35	318-FR	1		1					
36	319-FR	1		1					
37	320-FR	2		1					
38	321-FR	1		1					



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



Annexure III – Electronics & Communication Engineering

1	Gf	Geo Technical Engineers Lab	6	4					
10	Gf	Faculty Room	2						
11	Gf	Environment Eng lab	8	2					
12	Gf	Concrete Technology Lab	11	8					
13	Gf	Surveying Lab	1	2					
14	Gf	Lobby		5					
15	1st floor	Store Room		1					
16	1st floor	M tech Class room	3	2					
17	1st floor	Staff Room	2	2	1	1			
18	1st floor	Seminar Hall			1	1	3	1	
19	1st floor	HOD office	3	5	2	2	1		
2	107	Staff Room	2	2					
20		Staff Room	1	1					
21	1st floor	Tutorial Class Room	3	2					
22	1st floor	Staff Room	2	1					
23	1st floor	Computer lab	2		42	1	1	3	1
24	1st floor	Class Room	6	4					
25	1st floor	Department Library	3	2	1	1			
26	1st floor	Staff Room	1	1					
27	1st floor	Staff Room	1	1	1	1			
28	1st floor	Class Room	6	4					
29	1st floor	Class Room	6	4					
3	Gf	Environment Engineering Lab	8	2					
30	1st floor	Lobby		11					
31	2nd floor	Exam cell	25	24					
32	2nd floor	Spot Valuation Room	6	11			3		
33	2nd floor	Dept Controller of Examination Room	4	3	1	1			
34	2nd floor	Processing Hall	6	12					
35	2nd floor	Exam cell	1	1					
36	2nd	Printing Room	2	3	3		1	1	



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



S No	Room	Utility	Ceiling fans	Pedestal fans	Tube lights	Desktops	UPS	Printers	AC's	LCD projectors	Wireless routers
37	2nd floor	Exam cell	3		3	1		1	1		
38	2nd floor	Central Examination Co-ordinator	3		4						
39	2nd floor	Examination Cell	6		4	3					
4	GF	Concrete Technology Lab	11		8						
40	2nd floor	Record Room	2		3						
41	2nd floor	Coding & Decoding section	3		2						
42	2nd Floor	Lobby	4		5		1				
5	GF	Surveying Lab	1		2						
6	GF	Lobby			5						
7	1st Floor	Store Room			1						
8	1st Floor	M.Tech Class Room	3		2						
9	Gf	Geo Technical Eng Lab	6		6						

Annexure IV – Chemical Engineering

S No	Room	Utility	Ceiling fans	Pedestal fans	Tube lights	Desktops	UPS	Printers	AC's	LCD projectors	Wireless routers
1	D-102	Mechanical Operation Lab/Heat transfer Lab	7		7						
2	D-103	Staff Room	3		2						
3	D-104 & 105	Chemical Technology Lab	12		10	1	1	1			



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



4	D-106	HOD	2		2	1	1		1		
5	107	Seminar Hall		12	7				3	1	
6	108	Seminar Hall	12		9	1			3	1	
7	Gf	Lobby			4						1
8	201	Faculty Room	2		2	1	1	1	1		
9	D-202	CR LAB	8		6						
10	D-2013	Dept Library	1		2	3	1	1	1		
11	D-204&203	Biotechnology Lab	11		10						
12	D-206	Staff Room	2		2						
13	D-211	Seminar Hall	11		4						
14	D-209	Faculty Room	3		2	1					
15	D-208	Comuter Lab	7		4	16					
16	1st Floor	Lobby			3						1
17	302	Class room	5		6						
18	303	Class room	5		6						
19	304	Class room	5		6					1	
20	305	Class room	5		6						
21	306	Faculty Room	3		2						
22	308		7		4						
23	312	Class room	7		4						
24	2nd floor	Lobby			4						1
25	402	Process Dynamic Central Lab				1					
26	403	Class room	5		4						
27	404	Mass Transfer lab	12		10						
28	406	Faculty Room	2		2						
29	408	Class room	7		4						
30	412	Class room	7	4							
31		LOBBY			4						
32		TOTAL	151	16	138	25	4	3	9	3	3

Annexure V- Electrical & Electronics Engineering

S No	Room	Ceiling fans	Pedestal fans	Tube lights	Desktops	UPS	Printers	AC's	LCD projectors	Wireless routers
1	101-L	14		12						
2	102-FR	2		2	2	2	1	1		
3	105-L	11		12						



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



4	107-L	10		9										
5	108-L	10		9	1									
6	LOBBY		2	7								1		
7	201-CR	5	1	4										
8	202-CR	5		4										
9	203-FR	3		2										
10	204-WH	1	1	1										
11	205-L	12		10										
12	207-L	13		11										
13	208-FR	2		2	1	1								
14	209-LB	4	1	3	1	1								
15	210-FR	4	1	1										
16	LOBBY			2										1
17	301-CR	5		4								1		
18	302-CR													
19	303	3		3										
20	L	1		4	38	1			3					
21	306-EH	5		2	1	1	1							
22	307-CR	7		4										
23	309-FR	3		2	1									
24	310-FR	3		2										
25	311-FR	3		2	1									
26	312-FR	7		5								1		
27	LOBBY			4										
28	313-SR			2									1	
29	401-CR	8		4										
30	402-CR	8		2										
31	403-FR	2		2										
32	404-FR	2		2										
33	405-CR	8		4										
34	406-CR	6		3										
35	408-CR	7		5										
36	409-CR	3		2										
37	410-CR	3		2	1									
38	412-CR	10		5										
39	LOBBY			2										
40	TOTAL	190	0	158	47	6	2	4	3				1	3



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



Annexure VI – Information Technology

S No	Room	Utility	Ceilin g fans	Pede stal fans	Tub e light s	Deskto ps	UP S	Printer s	AC' s	LCD project ors	Wirele ss routers
1	301	WT LAB	1		8	28			1	1	
2	302	JAVA LAB	1		8	40	2	2	2		1
3	303	Project LAB	2		14	60	3	1	5	1	2
4	305	HOD	3		3	2	2	4	1		1
5	306	Faculty Cabin	2		1	1		1		1	
6	307	Class Room	6		6						
7	308	Staff Room	2		2	2					
8	309	Staff Room	2		2	2	1	1			
9	310	Class Room	6		6					1	
10	311	Class Room	6		5					1	
11	2nd floor	Lobby			3	4					
12	401	Class Room	6		5	1				1	
13	402	Class Room	6		5	1				1	
14	403	Faculty Cabin	2		2						
15	404		2		2	2		1			
16	406	Staff Room	6		4	3		2			1
17	407	De Lab									
18	408	Faculty Room	8		7	2	1	1			
19	409	Faculty Room	7		4	5	1	2			1
20	3rd floor	Lobby			3						
21	502& 503	IT Lab				130	2		11		
22	504	Faculty Cabin	4		2						
23	505	Faculty Cabin	2		2	1	1	1	1		
24	506	Faculty Cabin	4				1				
25	507	Class Room		6	4						
26	508	Staff Room	2		2						
27	509	Staff Room	2		2						
28	510	Class room	6		5						
29	511	Class room	6		5	1				1	
30		Lobby			8						



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



Annexure VII – CIVIL Engineering

S No	Room	Utility	Ceiling fans	Pedestal fans	Tube lights	Desktops	UPS	Printers	AC's	LCD projectors	Wireless routers
1	GF	Geo Technical Engineers Lab	6		4						
2	107	Staff Room	2		2						
3	GF	Environment Engineering Lab	8		2						
4	GF	Concrete Technology Lab	11		8						
5	GF	Surveying Lab	1		2						
6	GF	Lobby			5						
7	1st Floor	Store Room			1						
8	1st Floor	M.Tech Class Room	3		2						
9	GF	Geo Technical Eng. Lab	6		6						
10	GF	Faculty Room	2								
11	GF	Environment Eng. lab	8		2						
12	GF	Concrete Technology Lab	11		8						
13	GF	Surveying Lab	1		2						
14	GF	Lobby			5						
15	1st floor	Store Room			1						
16	1st floor	M tech Class room	3		2						
17	1st floor	Staff Room	2		2	1	1				
18	1st floor	Seminar Hall				1	1		3	1	
19	1st floor	HOD office	3		5	2	2		1		
20		Staff Room	1		1						
21	1st floor	Tutorial Class Room	3		2						
22	1st floor	Staff Room	2		1						
23	1st floor	Computer lab	2			42	1	1	3	1	
24	1st floor	Class Room	6		4						
25	1st floor	Department Library	3		2	1	1				
26	1st floor	Staff Room	1		1						
27	1st floor	Staff Room	1		1	1	1				
28	1st floor	Class Room	6		4						
29	1st floor	Class Room	6		4						
30	1st floor	Lobby			11						
31	2nd floor	Exam cell	25		24						
32	2nd floor	Spot Valuation Room	6		11				3		



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



33	2nd floor	Dept. Controller of Examination Room	4		3	1		1				
34	2nd floor	Processing Hall	6		12							
35	2nd floor	Exam cell	1		1							
36	2nd floor	Printing Room	2		3	3		1	1			
37	2nd floor	Exam cell	3		3	1		1	1			
38	2nd floor	Central Examination coordinator	3		4							
39	2nd floor	Examination Cell	6		4	3						
40	2nd floor	Record Room	2		3							
41	2nd floor	Coding & Decoding section	3		2							
42	2nd floor	Lobby	4		5		1					
43	3rd floor	Exam Cell	6		8							
44	3rd floor	Exam Cell	9		12							
45	3rd floor	Exam Cell	12		8							
46	3rd floor	Sports Room	5		5							
47	3rd floor	Gym	8	1	4							
48	3rd floor	Lobby			8							
49	5th floor	Dept. of Physics	19		13							
50	5th floor	Staff room	3		2	1	1	1	1			
51	5th floor	Staff room	2		1							
52	5th floor	Staff room	3		1							
53	5th floor	Staff room	2	7	1			1				
54	5th floor	Staff room	3		1							
55	5th floor	Staff room	3		1							
56	5th floor	Staff room	3		1	1	1					
57	5th floor	Staff room	3		1	1						
58	5th floor	Basic Science And Humanities	3		1	1	1					
59		HOD ROOM	3		2	1	1	1	1	1		
60		Staff Room	1		1	1	1					
61		Staff Room	1		1	1	1					



Energy Audit Report

ANIL NEERUKONDA INSTITUTE OF TECHNOLOGY & SCIENCE Sangivalasa, Visakhapatnam



62	Staff Room	1		1	1	1	1			
63	Staff Room	5		2	1	1	1			
64	Chemistry Lab	2		3	1	1				
65	Staff Room	3		1						
66	Lobby			9						
	TOTAL	244	0	240	66	17	9	14	2	0

Annexure VIII – Administration

S No	Room	Utility	Ceiling fans	Pedestal fans	Tube lights	Desktops	UPS	Printers	AC's	LCD projectors	Wireless routers
1	Gf	Director Room	1		2	1		1	1		
2	Gf	Secretarial Room	2		7	1	1	2	1		
3	Gf	Conference Room							2	1	1
4	Gf	Principal Room	4		5	1		2	1		
5	Gf	Office Room	1		1						
6	Gf	Office Room	11		11	10		2			
7	Gf	Store Room	3		3						
8	A-108	HOD	1		2	1	1	1	1		
9	A-109	Faculty Room	8		7	2					
10	A-110	Class Room	5								
11	A-111	Class Room	8		5						
12	A-112	Class Room	8		5						
13	113	Class Room	6		6						
14	Gf	Lobby	7		11						
15	1st floor	201	1		23	66	3		5	1	
16	1st floor	202	15		9	1	2			2	
17	1st floor	203	1		3	1	1	1	1		1
18	1st floor	204	6		9	3	2	3			
19		Office Room	1		2	1	1	1			
20		Class room	32		20	4	1				1
21		Lobby			6						
22	2nd floor	Auditorium				1				1	1
23	2nd floor	302	1		2				1		
24	2nd floor	303	1		1				1		
25	2nd floor	304	1		1				1		
26	2nd floor	305	1		1				1		
27	2nd floor	308	2		3				1		



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



28	2nd floor	309			15				6		1
29	2nd floor	310	1		2	1			1		
30	2nd floor	311	40		34						1
	2nd floor	Lobby	2		5						
		TOTAL	170	0	200	95	12	13	24	5	6

Annexure IX - Girls Hostel

S. no	Name of appliance	Power Rating (Watt)	Quantity	Power Consumption (Watt)	Average usage per day (hr)	Power Consumption/day (Watt)
A	B	C	D	E=C X D	F	G=E X F
1st floor						
1	Ceiling fans	80 W	13	0	12	0
2	Tube lights (LED) 4'feet	20W	6	120	6	720
3	Tube lights 4' feet	36 W	47	1692	6	10152
2nd Floor						
1	Ceiling fans	80 W	12	0	12	0
2	Tube lights (LED) 4'feet	20W	14	280	6	1680
3	Tube lights 4' feet	9 W	48	432	6	2592
3rd Floor						
1	Ceiling fans	36 W	12	0	12	0
2	Tube lights (LED) 4'feet	20 W	11	220	6	1320
3	Tube lights 4' feet	9 W	58	522	6	3132
4th Floor						
1	Ceiling fans	36 W	12	0	12	0
2	Tube lights (LED) 4'feet	20 W	5	100	6	600
3	Tube lights 4' feet	9 W	63	567	6	3402



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



Annexure X- Boys Hostel

S. no	Name of appliance	Power Rating(Watt)	Quantity	Power Consumption (Watt)	Average usage per day(hr)	Power Consumption /day (Watt)
A	B	C	D	E=C X D	F	G=E X F
A Block						
1	Ceiling fans	80 W	132	10560	12	126720
2	Tube lights (LED) 4' feet	20W	30	600	6	3600
3	Tube lights (LED) 1' feet	9 W	02	18	6	108
4	LED Bulbs	8W	12	96	6	576
5	Tube lights 4' feet	36 W	142	5112	6	30672
6	Tube lights 2' feet	20 W	08	160	6	960
7	Water cooler	2.8kwh/day	1	2800	day	2800
B Block						
1	Ceiling fans	80 W	212	16960	12	203520
2	Tube lights (LED) 4' feet	20W	32	640	6	3840
3	Tube lights (LED) 1' feet	9 W	96	864	6	5184
4	LED Bulbs	8W	81	648	6	3888
5	Tube lights 4' feet	36 W	216	7776	6	46656
6	Tube lights 2' feet	20 W	50	1000	6	6000
7	Water cooler	2.8kwh/day	1	2800	day	2800



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



Good Practices in Energy Management:

- The management has installed a rooftop Solar Power plant which accounts for around 10% of the total power consumption.
- The management have replaced most of the lighting with energy efficient LED lighting. The split Air – Conditioners installed in the campus are five star rated from Bureau of Energy Efficiency.



Audit Recommendations:

- It is recommended to draft an Energy Management policy and continuously monitor the consumption pattern of the Institution.
- It is recommended to maintain a log book and monitor the fuel consumption of Diesel Generator.
- It is recommended to conduct a Third Party Electrical Safety Audit annually in the campus premises.



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



4.0 WATER CONSUMPTION SCENARIO AT ANITS

The water is consumed in the *ANIL NEERUKONDA INSTITUTE OF TECHNOLOGY AND SCIENCES (ANITS)* campus for different purposes like drinking, gardening, cleaning and firefighting.

The campus depends upon ground water and municipal water for its daily needs. The campus utilizes 40 KLD of water from 4 bore wells, and has an installed capacity of 40 KLD above ground storage tanks. The mean distribution of the water for different uses is as follows

The drinking water consumption is estimated at 1.2 liters/head and 99 % of the campus population stays in the campus for less than 8 hours, the drinking water availability is reasonably good compared to the standard of 5 liters/head/24hrs.

Bore Well 1



Bore Well 2



Bore Well 3



Bore Well 4





Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



Good Practices in Water Management:

- The management has installed Rainwater harvesting pits in campus which will enable the runoff rain water during rainy season to percolate in the water harvesting pits which will restore the ground water level.
- The management has installed a R.O System in the campus with a capacity of 24000 LPD which will be utilized for safe drinking water and the R.O reject water of 10000 LPD will be generated and is used for cleaning and gardening purpose.
- The management has installed a Sewage Treatment Plant in campus which will be utilized to safely dispose the waste water generated from laboratories, central canteen and other departments in campus.

Rain Water Harvesting






Energy Audit Report


**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



Reverse Osmosis Plant

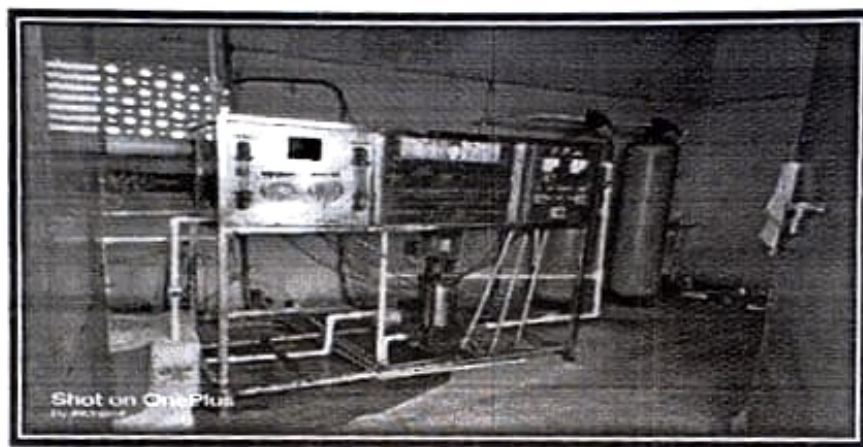

Sewage Treatment Plant

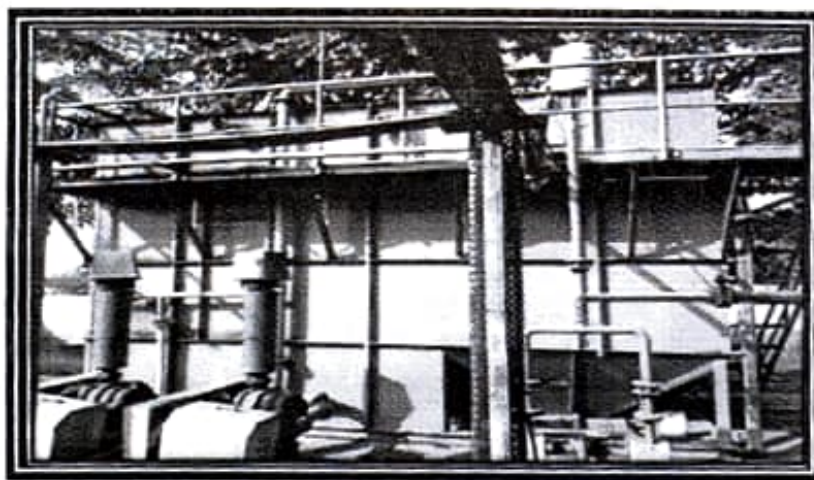



Energy Audit Report

**ANIL NEERUKONDA INSTITUTE OF
TECHNOLOGY & SCIENCE**
Sangivalasa, Visakhapatnam



Audit Recommendations:

- It is recommended to install water meters near bore wells to quantify the water utilization and prepare a water balance for the campus.
- It is recommended to maintain a log book and monitor the TDS, Hardness and pH of input and output water from the R.O Plant.
- Drip irrigation for gardens and vegetable cultivation can be initiated.
- It is recommended to install the low flow aerators for faucets in all common areas, restrooms and canteen and etc.

5.0 REFERENCE STANDARDS & REGULATIONS

- GRI Standards
- GHG Protocol Corporate Standard
- National Building Code 2016
- ISO 14064
- ISO 14040/44 Life Cycle Assessment
- ISO 46001 Water Efficiency Management
- ISO 14046 Water Footprint Standards
- True Rating Methodology for Waste Management
- Standards & Biodiversity by IISD
- IS 5216 - Guide for Safety Procedures and Practices in Electrical Work

Energy Audit Report



**ANIL NEERUKONDA INSTITUTE OF TECHNOLOGY AND SCIENCES (A)
(ANITS)**

Sangivalasa, Bheemunipatnam Mandal, Visakhapatnam,

Andhra Pradesh-531162, India

Preface

An energy audit is a study of a plant, building or facility to determine how much energy is used and to identify methods for energy savings. Proper balancing in implementation of the new technologies and already existing technology provide the most hopeful prospects for the future. The opportunities lie in the use of existing renewable energy technologies, enhancing the energy efficiency and the distribution of these technologies.

Data collection for energy audit of Anil Neerukonda Institute of Technology and Sciences (ANITS) Campus for the period of April 2020 to March 2021 has been done by the team. This audit was over sighted to inquire about the convenience to develop the energy competence of the campus. This audit is essential to identify the energy proficient appliances/instruments. The data is collected from each classroom, laboratory and every room by considering the number of tubes, fans, A.Cs, electronic instruments, water purifiers, printers, xerox machines, pumps, projectors etc., present in each room.

This report is just the first step, a mere mile marker towards our destination of achieving energy efficiency and we would like to emphasize that an energy audit is a continuous process. The team has compiled a list of potential actions to save and efficiently utilize the limited resources and identified their savings potential. The next step would be to prioritize their execution. The team look forward with optimism that the institute authorities, staff and students shall ensure the maximum execution of the recommendations and the success of this work.

**ANIL NEERUKONDA INSTITUTE OF TECHNOLOGY AND SCIENCES (A)
(ANITS)**

ENERGY AUDIT TEAM

S. No	Name	Designation	Role
1	Prof. G. Raja Rao	Professor & HOD Dept. of EEE	Coordinator
2	Dr. V. Murali	Associate Professor, Dept of EEE	Member
3	Dr. R. Satish	Assistant Professor, Dept of EEE	Member
4	Dr. T. Narasimhulu	Assistant Professor, Dept of EEE	Member
5	Dr. K. Venkata Rao	Deputy Executive Engineer, AP Transco	Industrial Expert

Highlights

- I. The total connected load as per the present energy audit is 2423.64 kVA.
- II. The institute has 450 kVA solar power generation. The total solar energy generation in the year 2020-21 is 4,92,227 kVAh/Annum.
- III. The total actual energy consumption in the campus during 2020-21 is 7,16,806 Units/Annum.
- IV. The college has paid total 40,15,795/- Rs/Annum for the electricity bill in 2020-21 which is equivalent to 31.33% of the actual energy consumed. This is due to the availability of solar plant in the campus.
- V. The contract demand is 450 kVA and monthly minimum consumption is 360 kVA. The average measured maximum demand maintained in the year is 120.99 kVA.
- VI. The institute has two capacitor banks of ratings 30 kVAR and 15 kVAR. The Average power factor maintained during the year is 0.9967.
- VII. The institute has a 500 kVA diesel generator set to supply the back-up power.

Contents

S. No	Title	Page no.
1	Preface	2
2	Highlights	4
3	Introduction	6
4	Survey and data collection	8
5	Results and discussion	17
6	Recommendations	21

Introduction

The energy audit is an inspection, survey and analysis of energy flows in building process or system to understand the energy dynamics of the system. The main objective of the energy audit in an occupied building is reduction of energy consumption without compromising the human comfort, health and safety. Energy audit is not only for the identification of the sources of energy use, it is to prioritize the energy uses according to the greatest to least effective opportunities for energy savings.

Energy audit will indicate the energy consumption, energy efficiency measures of the building. The energy manager can compare and analyze the trend in energy consumption against past and future levels for a proper energy management. The main part of the energy audit report is energy savings proposals comprising technical and economic analysis of projects. Looking at the final output, an energy audit can also define as a systematic search for energy conservation opportunities. This information can be transformed into energy savings project. It will facilitate the energy manager to draw up an action plan listing in the order of priority. Adopting this activity as a routine or part of the organizations culture gives life to energy management. Controlling the energy use by energy audit is known as Energy Management by facts.

Sustainable development of any nation is possible through the interminable energy management. India's industrial demand accounted for 44 % of electrical power requirement, transport 17 %, domestic household 14 %, agriculture 7 %, public lighting and other miscellaneous applications accounted for the rest. Coal, Oil and gas reserves of India are estimated to last just 100 years, 17.5 years and 40.2 years respectively at the current reserve to production (R/P) ratio. So this is the peak time to reduce energy consumption and efficiently use the same. Energy conservation means reduction in energy consumption without making any sacrifice of quantity or quality. A successful energy management program begins with energy conservation: it will lead to adequate rating of equipments, using high efficiency equipment and change of habits which causes enormous wastage of energy. By observing all these studies, lack of electricity and huge electricity demands, it is necessary to plan to being self sufficient in electricity requirement.

In the present study, institute electricity audit has been taken up. In this study practical laboratories, instruments, fans, air conditioners, computers, printers, Xerox machines, pumps, lift, etc., are considered. All the calculations have been done by collecting exact data from survey on the basis of rating or user of the particular instrument for how often/long they use that and all other required detail.



Fig.1 ANITS Campus

Survey and data collection

Data like number of lights, fans, ACs, printers etc., is collected by the ANITS EEE department technical staff and the data has also been verified by the team. The team has also did walk-through survey in laboratories and interacted with the in-charges for relevant information. The energy audit survey was also assisted by an industrial expert.

Table 1: Connected load in Administrative block (A)

Administrative Block (A)					
Description	Power (W)	No's	Total Power (W)	Total Power (kW)	Total Power (kVA)
CFL Bulbs	20	200	4000	4	5
Fans	60	170	10200	10.2	12.75
ACs	7000	24	168000	168	210
LCD Projectors	275	5	1375	1.375	1.72
Water Coolers	1550	1	1550	1.550	1.94
Printers	250	13	3250	3.250	4.06
Computers	160	95	15200	15.2	19
UPS	8000	3	24000	24	30
UPS	4000	2	8000	8	10
UPS	800	7	5600	5.6	7
Total:	--	--	241175	241.175	310.47

Table 2: Connected load in ECE block (B)

ECE Block (B)					
Description	Power (W)	No's	Total Power (W)	Total Power (kW)	Total Power (kVA)
CFL bulbs	20 W	172	3440	3.440	4.3
Fans	60	169	10140	10.140	12.675
ACs	7000	15	105000	105	131.25

LCD Projectors	275	10	2750	2.750	3.44
Water Coolers	1550	1	1550	1.550	1.94
Printers	250	3	750	0.750	0.94
Computers	160	119	19040	19.040	23.8
UPS	8000	2	16000	16	20
UPS	4800	1	4800	4.8	6
UPS	2400	1	2400	2.4	3
Total:	--	---	165870	165.870	207.34

Table 3: Connected load in CSE block (C)

CSE Block (C)					
Description	Power (W)	No's	Total Power (W)	Total Power (kW)	Total Power (kVA)
CFL Bulbs	20	129	2580	2.580	3.23
Fans	60	152	9120	9.120	11.4
ACs	7000	23	161000	161	201.25
Exhaust Fans	60	6	360	0.360	0.45
LCD Projectors	275	14	3850	3.850	4.81
Water Coolers	1550	2	3100	3.1	3.88
Printers	250	6	1500	1.5	1.88
Computers	160	217	34720	34.720	43.4
UPS	8000	3	24000	24	30
UPS	4800	8	38400	38.4	48
UPS	4000	1	4000	4	5
Total:	--	--	282630	282.630	353.29

Table 4: Connected load in Chemical block (D)

Chemical Block (D)					
Description	Power (W)	No's	Total Power (W)	Total Power (kW)	Total Power (kVA)
CFL Bulbs	20	138	2760	2.760	3.45
Fans	60	151	9060	9.060	11.33
ACs	7000	11	77000	77	96.25
Exhaust Fans	60	6	360	0.360	0.45
LCD Projectors	275	3	825	0.825	1.03
Water Coolers	1550	1	1550	1.550	1.94
Printers	250	3	750	0.750	0.94
Computers	160	25	4000	4	5
Refrigerator	750	1	750	0.750	0.94
UPS	4000	1	4000	4	5
Total Labs	--	--	33500	33.5	41.88
Total:	--	--	134555	134.555	168.2

Table 5: Connected load in EEE block (E)

EEE Block (E)					
Description	Power (W)	No's	Total Power (W)	Total Power (kW)	Total Power (kVA)
CFL Bulbs	20	158	3160	3.160	3.95
Fans	60	190	11400	11.4	14.25
ACs	7000	5	35000	35	43.75
Exhaust Fans	60	6	360	0.360	0.45
LCD Projectors	275	9	2475	2.475	3.09
Water Coolers	1550	3	4650	4.650	5.81
Computers	160	47	7520	7.520	9.4
UPS	8000	1	8000	8	10
Total Labs	--	--	225300	225.300	281.63
Total:	--	--	297865	297.865	372.33

Table 6: Connected load in Mechanical block (F)

Mechanical Block (F)					
Description	Power (W)	No's	Total Power (W)	Total Power (kW)	Total Power (kVA)
CFL Bulbs	20	276	5520	5.520	6.9
Fans	60	254	15240	15.240	19.05
ACs	7000	21	147000	147	183.75
Exhaust Fans	60	9	540	0.540	0.675
LCD Projectors	275	10	2750	2.750	3.44
Printers	250	4	1000	1	1.25
Computers	160	99	15840	15.840	19.8
UPS	8000	2	16000	16	20
Total Labs	---	--	34000	34	42.5
Total:	--	--	237890	237.890	297.36

Table 7: Connected load in IT block (G)

IT Block (G)					
Description	Power (W)	No's	Total Power (W)	Total Power (kW)	Total Power (kVA)
CFL Bulbs	20	120	2400	2.4	3
Fans	60	94	5640	5.64	7.05
ACs	7000	18	126000	126	157.5
Water Coolers	1550	1	1550	1.550	1.94
LCD Projectors	275	10	2750	2.750	3.44
Printers	250	7	1750	1.750	2.19
Computers	160	318	50880	50.880	63.6
UPS	60000	1	60000	60	75
Total:	---	---	250970	250.97	313.71

Table 8: Connected load in Civil block (H)

Civil Block (H)					
Description	Power (W)	No's	Total Power (W)	Total Power (kW)	Total Power (kVA)
CFL Bulbs	20	264	5280	5.280	6.6
Fans	60	259	15540	15.540	19.43
ACs	7000	22	154000	154	192.5
Water Coolers	1550	1	1550	1.550	1.94
LCD Projectors	275	4	1100	1.1	1.38
Speakers	10	4	40	0.04	0.05
Printers	250	1	250	0.250	0.31
Computers	160	76	12160	12.16	15.2
Xerox Machine	1800	4	7200	7.2	9
Xerox Machine	1000	5	5000	5	6.25
Lift	5500	1	5500	5.5	6.88
UPS	8000	4	32000	32	40
UPS	4000	8	32000	32	40
UPS	800	6	4800	4.8	6
Total Labs	--	--	28000	28	35
Total:	--	--	304384	304.42	380.53

Table 9: Connected load in General Power & Hostels

General Power & Hostels					
Description	Power (W)	No's	Total Power (W)	Total Power (kW)	Total Power (kVA)
CFL Bulbs	20	252	5040	5.04	6.3
Fans	60	49	2940	2.940	3.68
Water Coolers	1550	2	3100	3.100	3.88
Refrigerator & Others	--	--	5000	5	6.25
Water Pumps	2238	2	4476	4.476	5.60
Water Pumps	1492	2	2984	2.984	3.73
Total:	--	--	23540	23.54	29.43

Table 10: Total connected load in ANITS Campus

Total Connected Load				
S. No	Description	Total Power (W)	Total Power (kW)	Total Power (kVA)
1	Administrative block	241175	241.175	310.47
2	ECE block	165870	165.870	207.34
3	CSE block	282630	282.630	353.29
4	Chemical block	134555	134.555	168.2
5	EEE block	297865	297.865	372.33
6	Mechanical block	237890	237.890	297.36
7	IT block	250970	250.97	313.71
8	Civil block	304384	304.42	380.53
9	General power & Hostels	23540	23.54	29.43
Total		1938879	1938.915	2423.64

Solar Energy

Institute has 450 kVA solar power generation system with 1364 panels installed and is connected to the grid. The energy units consumed from the public supply is exclusive of this power. Thus, addition of this power, accounts for a per capita consumption of 1963.85 Units/Day.

Table 11: Solar system at ANITS Campus

Campus Solar System								
S. No	Panel Info.	EEE block	ECE block	CSE block	Chemical block	Mech block	IT block	Girls Hostel
1	Company	ORB Energy	ORB Energy	ORB Energy	ORB Energy	ORB Energy	ORB Energy	ORB Energy
2	Inverter make	Schneider	Schneider	Schneider	Schneider	Schneider	Schneider	Schneider
3	No. of Modules	209	209	209	209	220	160	148
4	Power	330 Wp	330 Wp	330 Wp	330 Wp	330 Wp	330 Wp	330 Wp
5	Total Power (kWp)	68.97kWp	68.97kWp	68.97kWp	68.97kWp	72.6 kWp	52.8 kWp	48.84 kWp
6	Inverter Rating	66 kVA	66 kVA	66 kVA	66 kVA	66 kVA	66 kVA	66 kVA
7	No. of Inverters	01 No	01 No	01 No	01 No	01 No	01 No	01 No



Fig. 2 Bird Eye view of ANITS Campus

Table 12: Total energy consumption (kVAh), Solar share (kVAh), Measured maximum connected load (kVA) and electricity bill (Rs.) paid by college (from April 2020 to March 2021)

S. No	Month	Energy consumed from grid (kVAh)	Maximum demand (kVA)	Bill paid (Rs.)	PF
1	Apr	32030	99.92	135982	1
2	May	35254	123.6	231972	0.99
3	June	34923	106	346449	0.99
4	July	34890	112.32	327189	1
5	Aug	39197	126.96	402848	1
6	Sep	41216	122.08	389423	0.99
7	Oct	36726	113.52	320297	1

8	Nov	30540	100.48	225889	1
9	Dec	29760	96.16	211556	1
10	Jan	36663	119.44	287842	1
11	Feb	43862	144.56	432527	1
12	Mar	72208	186.88	703821	0.99
		Total: 4,67,269	Avg.: 120.99	Total: 40,15,795	Avg.: 0.9967

Table 13: Solar energy generation, energy fed to the grid, energy consumption from grid and actual energy consumed

S. No	Month	Solar generation (kVAh)	Energy fed to the grid (Solar Share) (kVAh)	Electricity consumed from Solar Unit (kVAh)	Actual energy consumed (kVAh)
1	Apr 2020	50628	34534	16094	48124
2	May	51976	32180	19796	55050
3	June	30951	13706	17245	52168
4	July	33655	16236	17419	52309
5	Aug	27695	10874	16821	56018
6	Sep	34852	14724	20128	61344
7	Oct	38616	19028	19588	56314
8	Nov	47563	28810	18753	49293
9	Dec	48410	31728	16682	46442
10	Jan	45044	23318	21726	58389
11	Feb	38702	11914	26788	70650
12	Mar	44135	5638	38497	110705
Total		4,92,227	2,42,690	2,49,537	7,16,806

Results and Discussion

As far as the energy audit is concerned, electricity audit is the main concern regarding educational institutions. The details of the energy consumption is given in the following Figures.

Fig. 3 shows the month wise total energy consumption, energy consumption from grid and energy consumed from solar unit.

Fig. 4 shows the month wise measured maximum demand.

Fig. 5 shows the month wise electricity bill paid.

Fig. 6 shows the month wise total energy generation from solar unit, energy fed to the grid and energy consumed from solar unit.

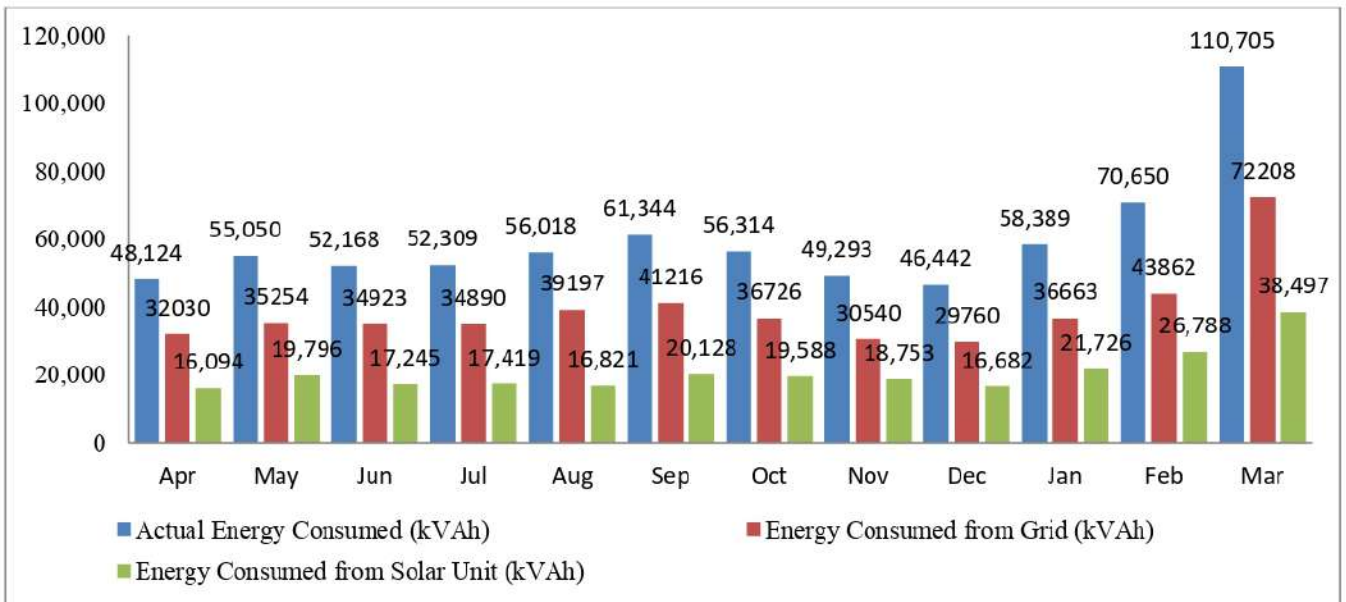


Fig. 3 Month wise total energy consumption, energy consumption from grid and energy consumption from solar unit



Fig. 4 Month wise measured maximum demand

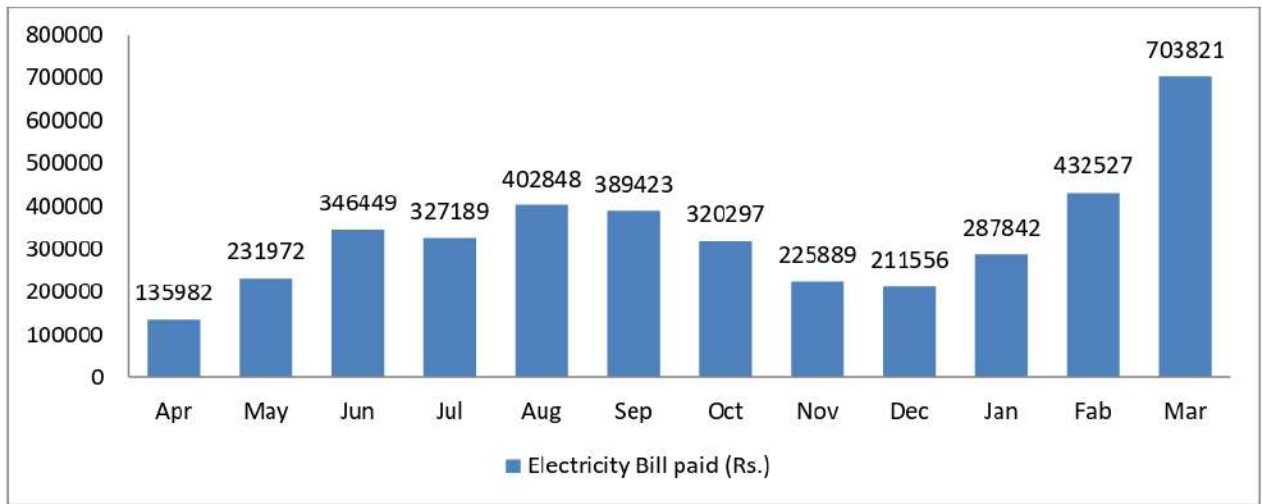


Fig. 5 Month wise electricity bill paid


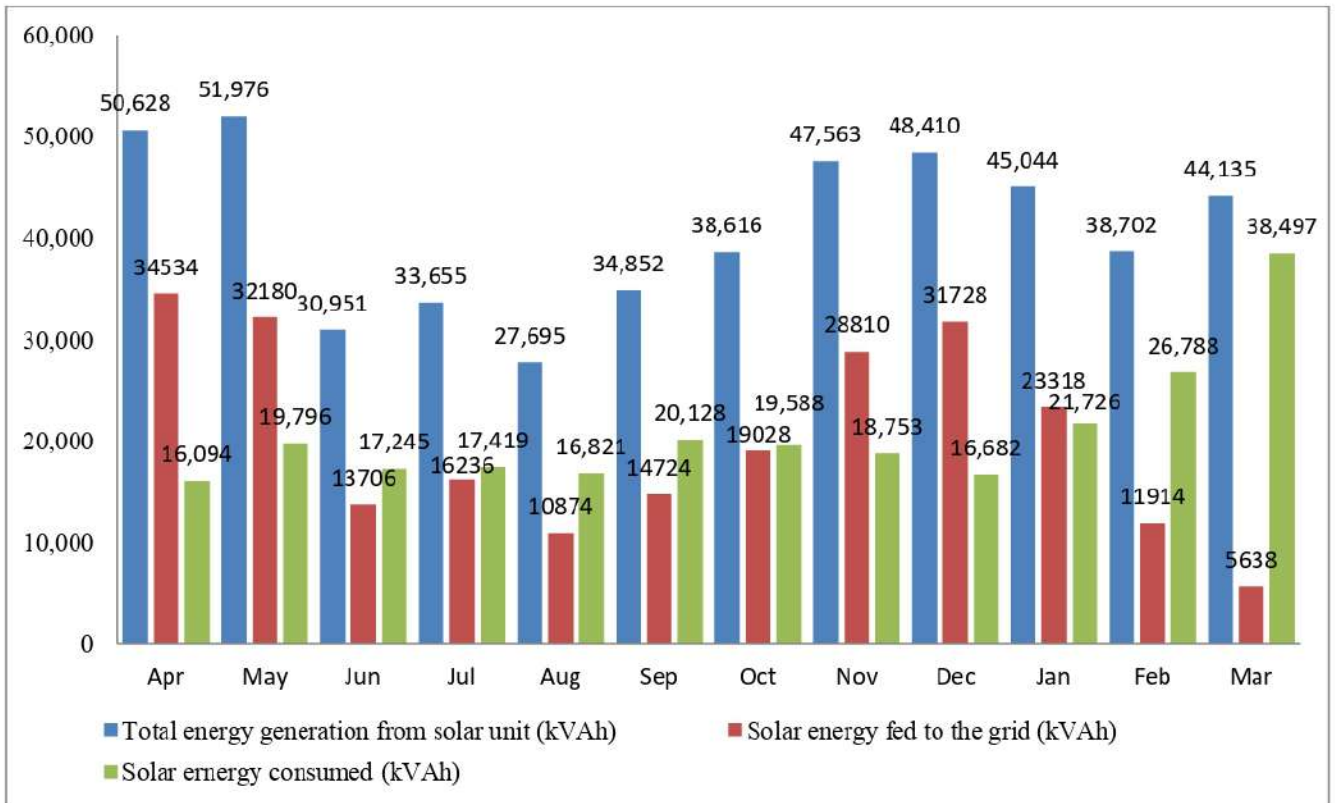


Fig. 6 Month wise total energy generation from solar unit, energy fed to the grid and solar energy consumed.


The actual energy consumed in 2020-21 is 7,16,806 Units/Annum. Out of this, the solar unit is contributing 2,49,537 Units/Annum (i.e., 34.81%). The remaining 4,67,269 Units/Annum (i.e., 65.19%) are consumed from the grid.

Contribution of actual energy consumption in 2020-21

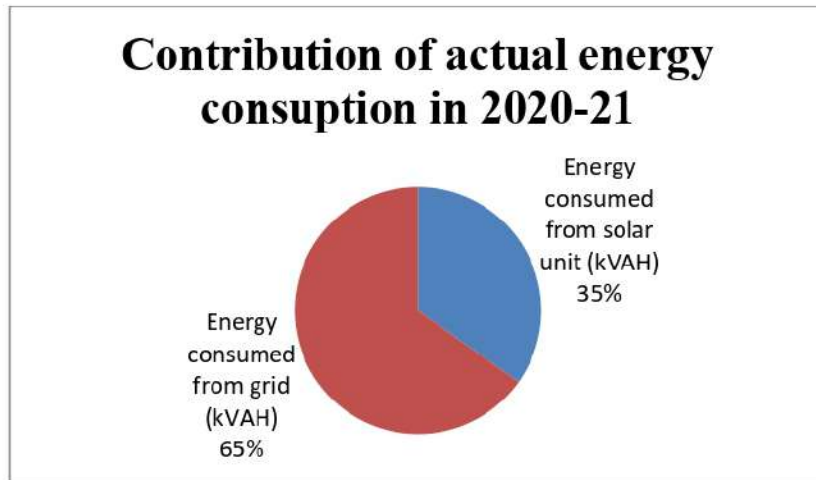

The solar unit is generated 4,92,227 Units/Annum in 2020-21. Out of this 2,42,690 Units/Annum (i.e., 49.30%) are fed to the grid. The remaining 2,49,537 Units/Annum (i.e., 50.70 %) are used in the campus.

Contribution of solar energy generation in 2020-21

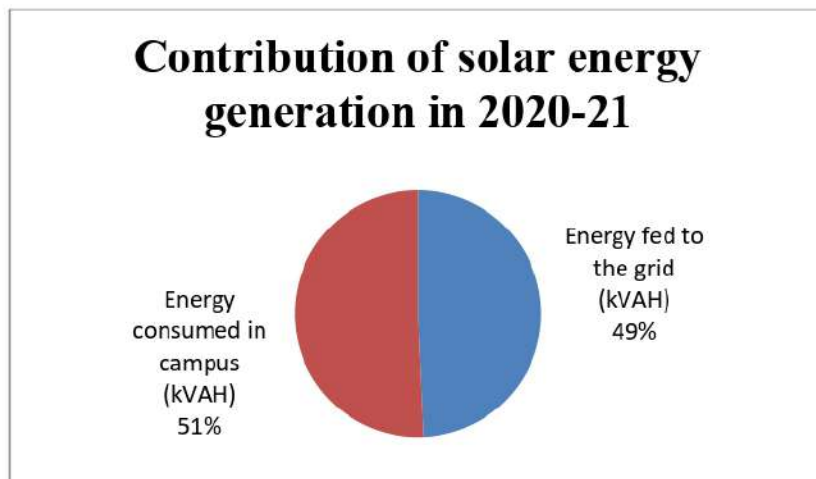

It is observed in 2020-21 that, the actual energy consumption is 7,16,806 Units/Annum. And the total solar energy generation is 4,92,227 Units/Annum (i.e., 68.67% of the actual energy consumed). The college has paid a total of 40,15,795/- Rs/Annum for the electricity bill which is equivalent to the bill for 2,24,579 Units/Annum (i.e., 31.33% of the actual energy consumed). Hence, ANITS has saved more than Rs. 80 Lakh/Annum in electricity bill during 2020-21 because of the use of solar power.

Recommendations

1. AC energy savers can be used to reduce the energy consumption of AC by 30-40 %.
2. LED bulbs can be used to save more electricity. The luminary distributions in rooms needs to be improved.
3. Street lights can be replaced with 7 W lithium battery based solar street or solar mass lights.
4. Solar off-grid system can be installed to supply back-up power instead of 500 kVA diesel generator set. The diesel generation set is not eco-friendly and also involves the consumption of costly diesel.
5. The institute has two 3 HP and two 2 HP water pump sets. These can be replaced with solar water pump sets.


ENERGY AUDIT COMMITTEE



Dr. T. Narasimhulu
Asst. Prof, Dept. of EEE



Dr. R. Satish
Asst. Prof, Dept. of EEE



Dr. V. Murali
Associate Professor, Dept. of EEE



8/9/2021

Prof. Dr. G. Raja Rao
HOD, Dept. of EEE
Head of the Department
ELECTRICAL & ELECTRONICS ENGINEERING
ANITS, Sanghavi, Visakhapatnam-531 148

K. Venkata Rao
Dr. K. Venkata Rao

Deputy Executive Engineer, AP Transco, Visakhapatnam

220 KV VSS
A.P. TRANSCO

Audit Team:

Dr.B. Vinay Sagar

(Chief Enevironmental consultant)

K.Srinija Aparna

(Environmental Consultant)

Sanchari Biswas

(associate consultant)

P.V.R Sravya

(Assistant professor ,Civil Department)

PRAGNANAM BRAHMA
ANITS

#	Content	Pages
1	Preface	3
2	Acknowledgement	5
3	Energy Audit	6
4	Recommendations & Conclusions	18
5	Annexures	19

PRAGNANAM BRAHMA
ANITS

Preface


ANITS have entrusted the Energy Audit work to M/s ENVIRO KAMKAR LLP. There after both teams i.e ANITS and Enviro KAMKAR has formed a collaboration in the working process. The work has initially started with the minutes of the meeting with ANITS principal, there after decision has been taken by the both the teams for the entire process. The external Energy audit team (team Enviro KAMKAR) has made sure to gather the entire consumption data of the campus for further analysis and presented. And, ANITS as an internal Audit team has given the esteemed support in gathering and segregating the data in this exercise.



ANITS-ENTRANCE

Acknowledgment

Team Enviro KAMKAR LLP is very great full to the principal of ANITS Engineering college and for the entire administrative team for trusting and relaying on us for Energy Audit. It is an honorable opportunity to work for ANITS and we will always be delighted to assist you further more in more such works to be the best green Institute in India.

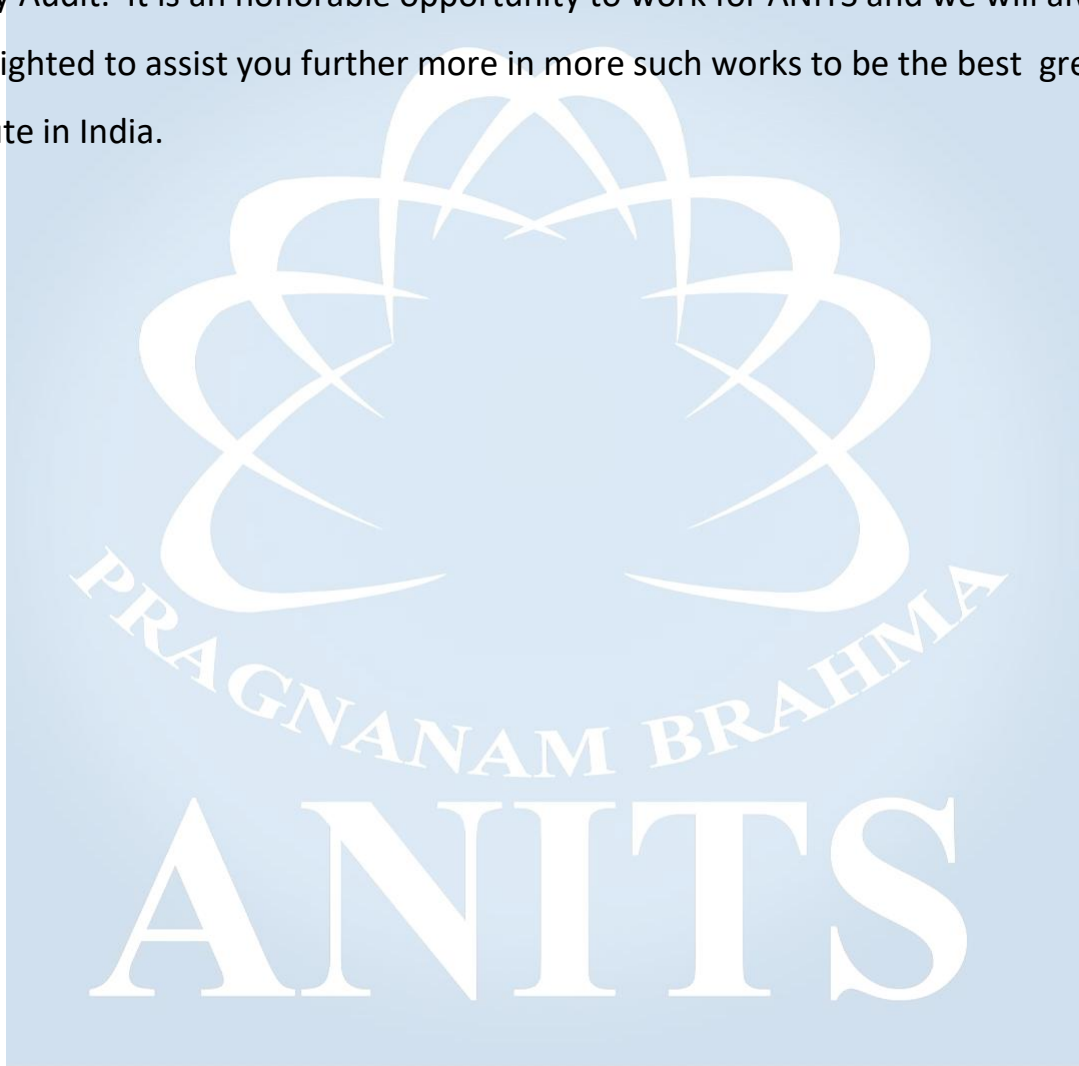

Energy Audit

Introduction

The National Environmental Policy (NEP) 2006, of India has made Environmental audit a mandatory to all industries, and the industries need to submit EA report every year in the prescribed format. The audit reveals how environmental friendly the industry is, and also enable the industries to improve their performance in the conservation of natural resources. The process is several industries has led several innovative interventions in the management of the environment. The NEP also prescribes the role of educational institutions in buildings capacity of all citizens of the country to perform their fundamental duty to the environment as delineated in articles 21 and 51 A (G). Realizing the need and importance of all these major agencies of educational governance like UGC, AICTE and School boards have recommended for the green audits and Energy audits in the educational institutions and have made it mandatory for accrediting the institutions. Enviro KAMKAR LLP facilitates the Green and Energy audits in the Educational institutions and participates as a third party auditor.

The objectives of the Energy Audit:

- To recognize the initiations taken by the institutions towards the Environment and energy resources
- To provide baseline data to enable institute to evaluate and manage the energy consumption.
- To provide recommendations to reduce energy consumption.

- To give preference to meet energy efficient and environmentally sound appliances.
- To make sure the institute is complying all the standards according to NEP,UGC, and AICTE.

Data collection from various Departments of ANITS

#	Name of the department	Annexure number
1	CSE	<i>Annexure I</i>
2	MECHANICAL	<i>Annexure II</i>
3	ECE	<i>Annexure III</i>
4	CHEMICAL ENGINEERING	<i>Annexure IV</i>
5	EEE	<i>Annexure V</i>
6	IT	<i>Annexure VI</i>
7	CIVIL	<i>Annexure VII</i>
8	ADMINISTRATION	<i>Annexure VIII</i>
9	GIRLS HOSTEL (BLOCK A & B)	<i>Annexure IX</i>
10	BOYS HOSTEL (BLOCK A & B)	<i>Annexure X</i>



INTERNAL VIEW OF ANITS CAMPUS

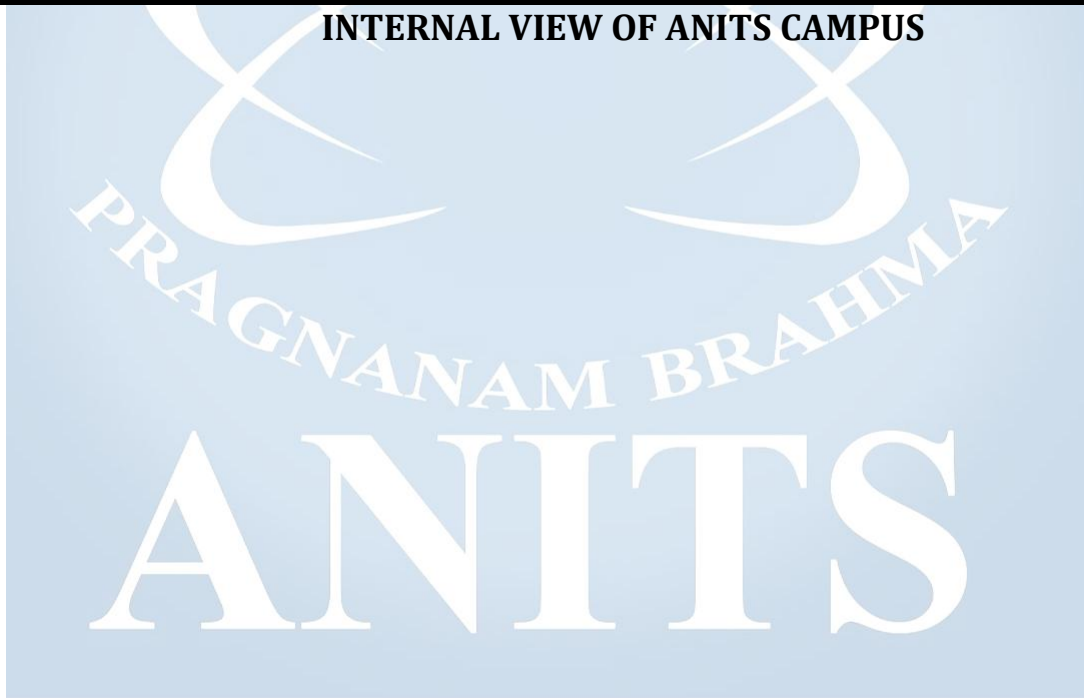


Table: Appliances and their power consumption rates in Campus & Girls Hostel

S. no	Name of appliance	Power Rating(Watt)	Quantity	Power Consumption (Watt)	Average usage per day (hr.)	Power Consumption/day (Watt)
A	B	C	D	E=C X D	F	G=E X F
1	Ceiling fans	80 W	1686	134880	6	809280
2	Pedestal fans	55 W	43	2365	6	14190
3	Tube lights (LED)	20W	1469	29380	6	176280
4	Desktops	50 W	783	39150	6	234900
6	Printers	50 W	67	3350	2	6700
7	AC's	2000 W	332	664000	4	2656000
8	LCD projectors	280 W	116	32480	2	64960
9	Wireless routers	6 W	37	222	24	5328
10	Window AC's	1400W	3	4200	4	16800
11	CC camera	10 W	153	1530	24	36720

ANITS

Table: Power consumption pattern in Boys hostels


S. no	Name of appliance	Power Rating(Watt)	Quantity	Power Consumption (Watt)	Average usage per day (hr.)	Power Consumption/day (Watt)
A	B	C	D	E=C X D	F	G=E X F
A Block						
1	Ceiling fans	80 W	132	10560	12	126720
2	Tube lights (LED) 4'feet	20W	30	600	6	3600
3	Tube lights (LED) 1'feet	9 W	02	18	6	108
4	LED Bulbs	8W	12	96	6	576
5	Tube lights 4' feet	36 W	142	5112	6	30672
6	Tube lights 2' feet	20 W	08	160	6	960
7	Water cooler	2.8kwh/day	1	2800	day	2800
B Block						
1	Ceiling fans	80 W	212	16960	12	203520
2	Tube lights (LED) 4'feet	20W	32	640	6	3840
3	Tube lights (LED) 1'feet	9 W	96	864	6	5184
4	LED Bulbs	8W	81	648	6	3888
5	Tube lights 4' feet	36 W	216	7776	6	46656
6	Tube lights 2' feet	20 W	50	1000	6	6000
7	Water cooler	2.8kwh/day	1	2800	day	2800

ANITS is one of the few institutions in India to have pioneered in the energy conservation and use of renewable energy sources. Basically it uses three types of Energy sources: (1) Electricity from the Public supply and (2) Electricity from the Own Solar plants and (3) Diesel (HSD).

The Institute during the audit year has consumed **2867/day** units with a mean of **87194** units per month. However, the monthly variations were very high and ranged from a low of **43766 units** in January to a high of **120240** units in September. From September to January, the consumption decreased gradually, despite the fact that the period may have peak academic activity. This indicates that the energy efficiency can be enhanced further in its use.

The declined power consumption from September to January indicates could be due to reduced use of Air conditioners. The Institution has a total of 332 air conditioners together have a cooling capacity of **500 tons**. The illumination and air circulation in the facilities needed examination.

On the whole, the per capita electricity consumption in the institute is around **219 units/annum**, which is reasonably good in Educational Institutions.

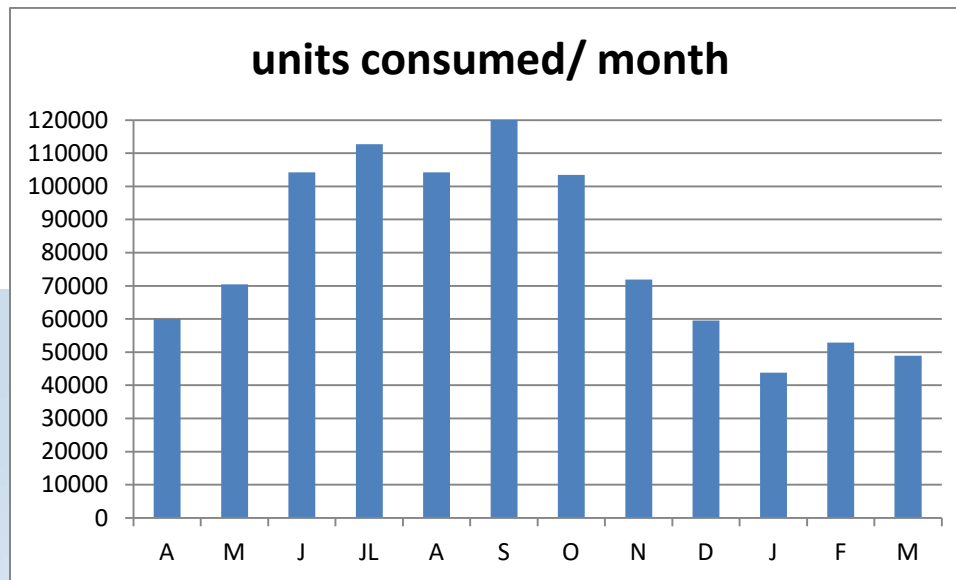

Considering the monthly consumption data, it has been recorded that **952377** units of electricity has been consumed by the institute among which it is observed that September month has utilized the highest amount of Electric energy i.e. **120000 units**, and lowest i.e. **43766 units** in the month of January. The following table presents the Energy bill of the same units.

Fig: Pie- chart depicting Annual Power consumption (Departmental - wise)

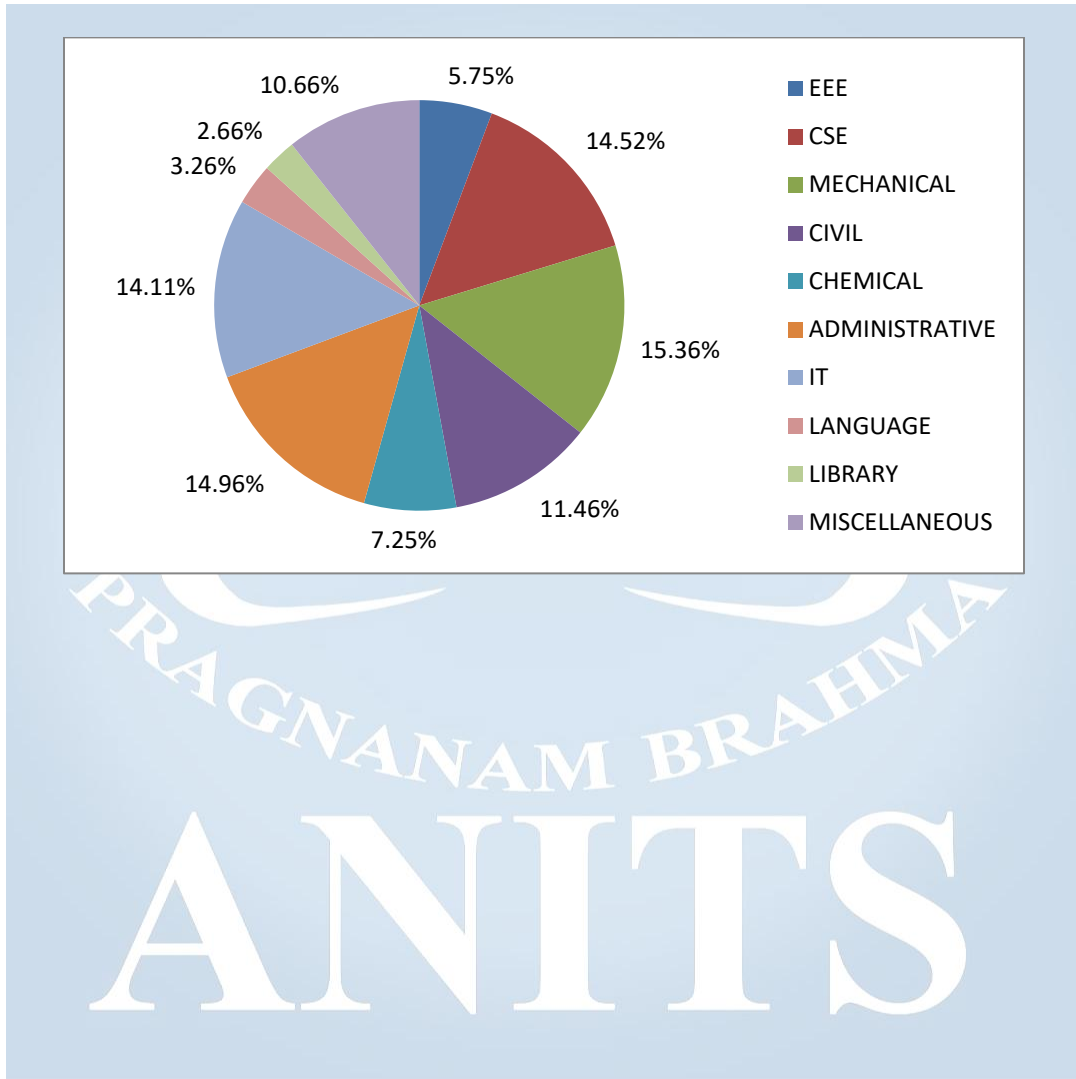



Table : Emission patterns of CO₂, SO₂, NO₂ monthly wise

S. no	Month	No. of units	CO ₂ in MT(0.91 kg/kWh)	SO ₂ in MT(6.94 g/kWh)	NO ₂ in MT(4.22 g/kWh)
1	April	60006	54.6	416.4	253.2
2	May	70467	64.1	489.0	297.4
3	June	104277	94.9	723.7	440.0
4	July	112725	102.6	782.3	475.7
5	August	104250	94.9	723.5	439.9
6	September	120240	109.4	834.5	507.4
7	October	103442	94.1	717.9	436.5
8	November	71896	65.4	499.0	303.4
9	December	59512	54.2	413.0	251.1
10	January	43766	39.8	303.7	184.7
11	February	52836	48.1	366.7	223.0
12	March	48960	44.6	339.8	206.6
	TOTAL	952377	866.7	6609.5	4019.0

Reference for calculation: Mittal, Moti & Sharma, Chhemendra & Singh, Richa. (2012). Estimates of Emissions from Coal Fired Thermal Power Plants in India. 2012, International Emission Inventory Conference

Solar Energy

Institute has 450 KVA solar power generation systems with 1364 panels installed and is connected to the grid. Therefore, Energy units consumed from the public supply are exclusive of this power. Thus, addition of this power, accounts for a per capita production of **19** units/annum.

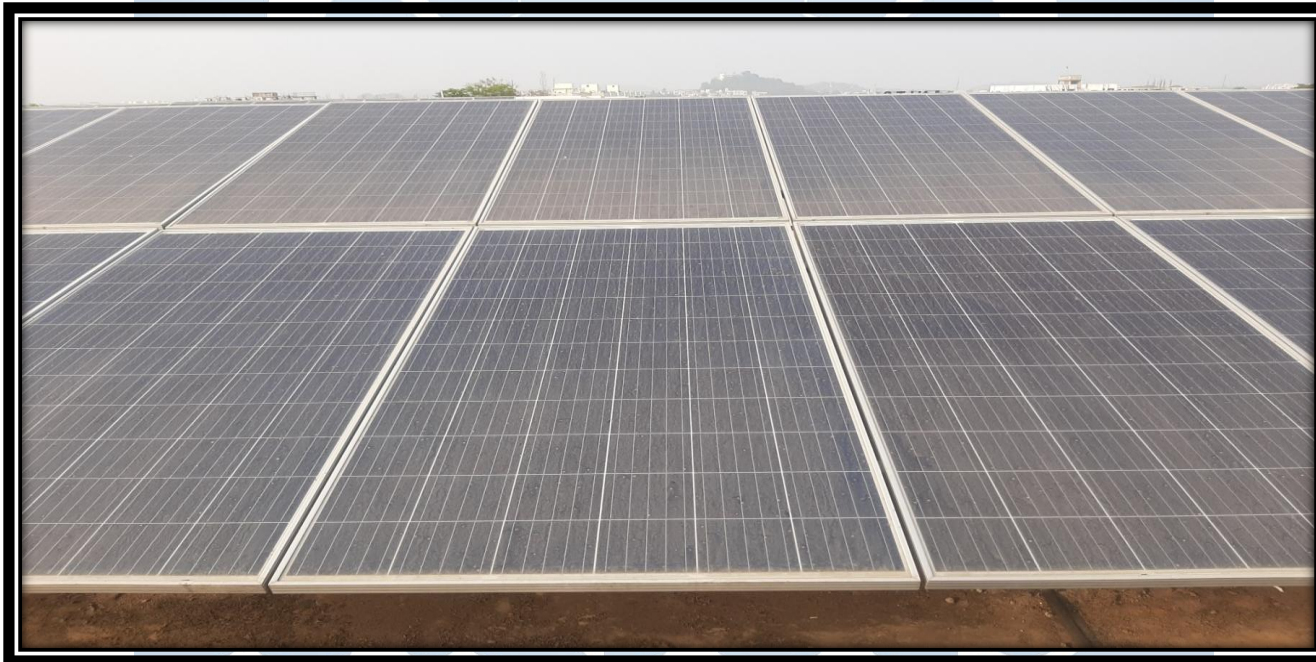

SOLAR MODULES

Campus Solar Panels								
#	PANEL INFO	EEE	ECE	CSE	CHEMICAL ENG	MECH	IT	RESIDENTIAL GIRLS HOSTEL
1	COMPANY	ORB Energy	ORB Energy	ORB Energy	ORB Energy	ORB Energy	ORB Energy	ORB Energy
2	INVERTER	Schneider	Schneider	Schneider	Schneider	Schneider	Schneider	Schneider
3	NO.OF MODULES	209	209	209	209	220	160	148
4	POWER	330Wp	330Wp	330Wp	330 Wp	320 Wp	330 kWP	330 kWP
5	TOTAL POWER(KWP)	68.97kWp	68.97	68.97	68.97 kWP	72.6 kWP	52.8 kWP	48.84 kWP
6	INVERTER RATING	66 kVA	66kVA	66kVA	66 kVA	66 kVA	66 kVA	66 KVA
7	NO.OF INVERTERS	01	01	01	01	01	01	01

PRAGNANAM BRAHMINIA
ANITS

FUEL ENERGY

Fuel Energy second major use sector for energy is Transportation sector of the Institute. On all working days, the Institute's fleet of Buses and vehicles ply a part of the campus population. The audit results indicate, the Institute's transportation by buses covers a distance ranging from **28400 km/month** to **65822 km/month**, with a mean of **44946 km/month**. The transportation consumption of oil ranges from 6600 litres/month to 15380 litres/month, with a mean of **11483 litres/month**. Another **884 litres/month** of HSD is consumed by administrative vehicles. Thus, the institution transportation covers around **35%** of the campus population. The remaining **65%** attend by various means, like, public transport (**16%**), private hired transport vehicles mostly 3 wheeler rickshaw (**27%**) vehicles, and about **8%** of the population uses their own vehicles as was revealed from the rapid survey.

By maximizing the entropy of the transportation data, it is estimated that all the travel trips of the campus population had a per capita HSD consumption was arrived at **83.82 liters/annum**.


ANITS also uses LPG fuel for its hostel messes and in some laboratories also. The evidences revealed that the annual consumption of LPG in all the facilities for the year 2019-2020 was **560 kg**.

On the whole, during the year 2019-2020, the ANITS has CO₂ emission of **867 tons** from use of electricity, and 356 tons from HSD Oil consumption, and **1.7** tons from LPG consumptions. Thus from the three major sources of energy, around **1224** tons of CO₂ emissions were released. However, by way of solar power generation of **93960 kWh**, about **86** tons of CO₂-e could be saved

mitigated.

Recommendations and Conclusions

- The Auditors appreciate the Management for replacing most electrical lights with energy efficient (LED) systems; generation of Solar power and reduced use of air-conditioning systems. However, the energy use from transport system can be improved significantly. Focus is to be made that the Institute buses should achieve 5 km/l from the present mean of 4.27 km/l.
- The Institute can further enhance its Solar Power production. Presently, the solar power accounts for around 10% of the total power consumption. Considering the present annual expenditure of Rs. 90 lakhs/annum, the institute can plan for a 1 MW solar power plant, and can not only realize the investment in 5 years, but also can make the campus Carbon neutral.

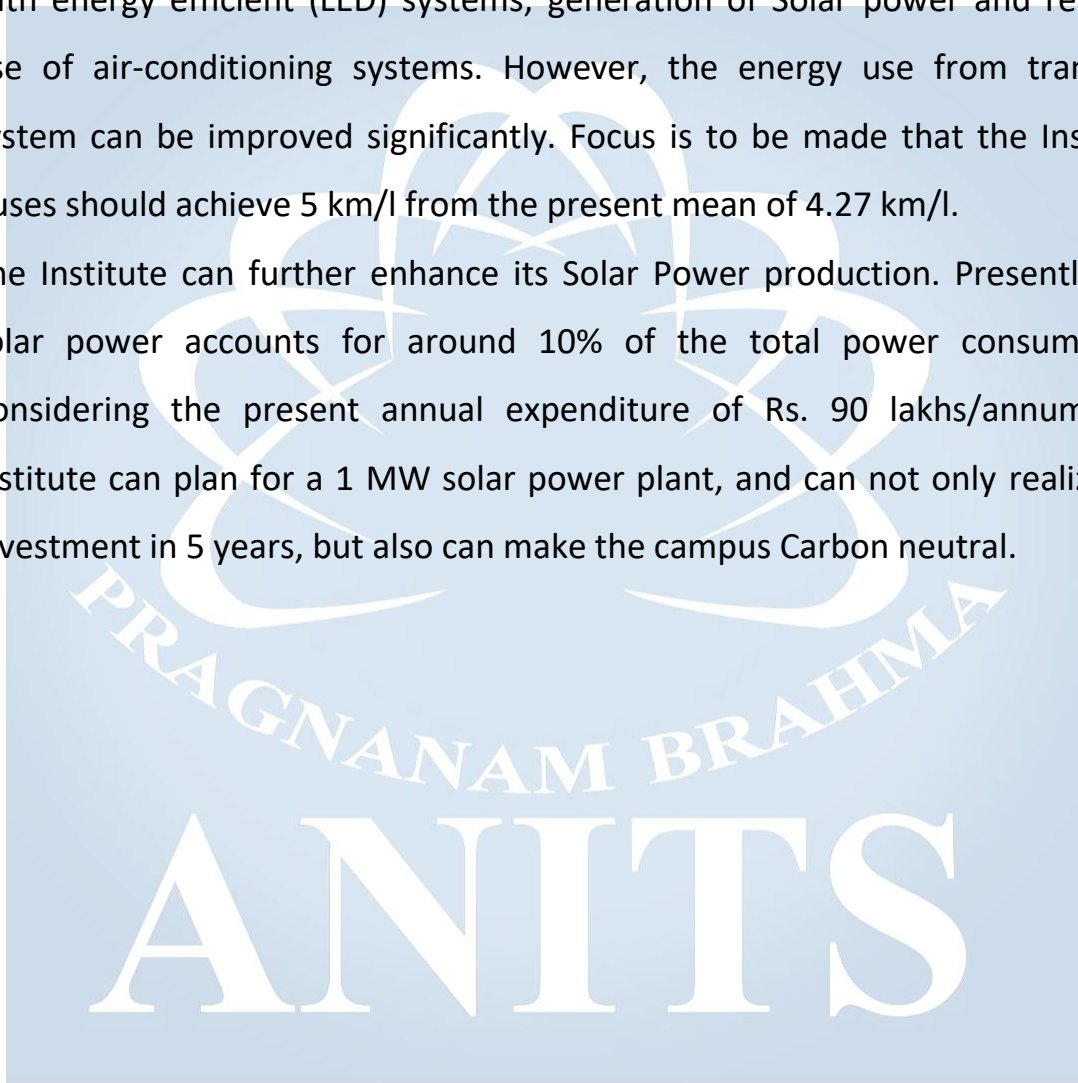

Annexure

Annexure I – CSE											
S No	Room	Ceiling fans	Pedestal fans	Tube lights	Desktops	UPS	Printers	AC's	LCD projectors	Wireless routers	Window AC's
1	101 -CR	5		4					1		
2	102 -FC	3		3							
	103 -FC	3		3	1	1					
	104 -CR	5		5					1		
	105 -FC	2		2			1				
	106 -FC	4	2	4		1	1				
	107-L		1		37				1		3
	108 -FC	2		3	5		1	1			
	109 -SR	1		3				2			
	110-L		1		36			3			
	111-L	4		2	15						
	Lobby			4							
	201-cabin	4	1	3	2						
	202-L		1		1	2		3	1		
	203 -FC	2		2	1	1	1	1			
	205 -CR	7		5					1	1	
	206 -CR	7		5					1		
	207 -CR	8		8	60	3		4	1		
	208-L	6		5		2					
	209-O	3		3	1	1	1				
	301-LB	4		3							
	302-L			4				2			
	303-CR	4		4	1	1	1	1			
	304-SR	2		2	2	2					
	306-CR	7		5					1		
	307-CR	7		5					1		
	309-CR	7		5							
	310-FR	3		2	1	1					
	311-FR	3		2							
	312-FR	3		2	1	1					
	313-CR	7		5					1		
	401-L	12		10	16	1		3			
	402-FR	2		2	1	1					
	403-FR	2		2							
	404-CR	5		4					1		
	405-CR	5							1		
	407-CR	7		5					1		
	408-L	1			36	1					
	409-CR	8							1		
	Lobby	1		3							
	TOTAL	152	6	129	217	19	6	20	14	1	3

CR-CLASS ROOM,
FR-FACULTY ROOM,
L-LABORATORY,
FC-FACULTY CABIN


<i>Annexure II - Mechanical</i>										
S No	Room	Ceiling fans	Pedestal fans	Tube lights	Desktops	UPS	Printers	AC's	LCD projectors	Wireless routers
1	101 -L	16		19						
2	102 -FD	5		4						
3	103 -EC	5		3	2	1	2		1	
4	103A -FR	1		1						
5	104-FR	2		3	1	1	2	1		
6	105-L	1		6	1			2		
7	105 A-FR	1		1	1	1				
8	106-L	5		4						
9	107-L	6		3						
10	108-L	13		10	1					
11	LOBBY			5						
12	201-DH	12		10						
13	202-CR	5		3					1	
14	203-CR	5		4					1	
15	204-CR	5		5						
16	205-CR	5		3						
17	206-CR	6		5					1	
18	207-CR	6		4						
19	208-DH	10		14						
20	LOBBY			5						
21	301-L	5	1	11	70	2		6	1	
22	303-L	2		2						
23	304-FR	1		1	1					
24	305-FR	1		1						
25	306-FR	1		1						
26	307-FR	1		1						
27	308-FR	1		1						
28	309-FR	1		1						
29	310-FR	3		2						
30	311-311LIBRARY	3		2	2					
31	312-FR	3		2	1	1				
32	314-FR	4		2						
33	315-CR	5		3					1	
34	317-FR	1		1						
35	318-FR	1		1						
36	319-FR	1		1						
37	320-FR	2		1						
38	321-FR	1		1						

39	323-CR	5		5						
40	324-DH	14		10						
41	Lobby									
42	401-SD			6	16	1		4	1	
43	401B-CH			6				2		
44	404-CR	2		6						
45	405-FR	1		2						
46	406-FR	1		1	1					
47	407-FR		1	1						
48	408-FR	1		1						
49	409-FR	1		1						
50	410-FR	1		1						
51	411-CR	8		1					1	
52	413-FR	4		5	2	1				
53	414-CR		7	4						
54	416-FR	1		4						
55	418-CR	7		1					1	
56	420-CR	7		4						
57	421-SH			24				6	1	
58	LOBBY			9						
59	LAB	22		10						
60	LAB	13		7						
61	WS	20		13						
62	LOBBY			3						
	TOTAL	254	9	276	99	8	4	21	10	0



Annexure III – ECE											
S No	Room	Utility	Ceiling fans	Pedestal fans	Tube lights	Desktops	UPS	Printers	AC's	LCD projectors	Wireless routers
1	GF	Geo Technical Engineers Lab	6		4						
2	107	Staff Room	2		2						
3	GF	Environment Engineering Lab	8		2						
4	GF	Concrete Technology Lab	11		8						
5	GF	Surveying Lab	1		2						
6	GF	Lobby			5						
7	1st Floor	Store Room			1						
8	1st Floor	M.Tech Class Room	3		2						
9	Gf	Geo Technical Eng Lab	6		6						
10	Gf	Faculty Room	2								
11	Gf	Environment Eng lab	8		2						
12	Gf	Concrete Technology Lab	11		8						
13	Gf	Surveying Lab	1		2						
14	Gf	Lobby			5						
15	1st floor	Store Room			1						
16	1st floor	M tech Class room	3		2						
17	1st floor	Staff Room	2		2	1	1				
18	1st floor	Seminar Hall				1	1		3	1	
19	1st floor	HOD office	3		5	2	2		1		
20		Staff Room	1		1						
21	1st floor	Tutorial Class Room	3		2						
8i22	1st floor	Staff Room	2		1						
23	1st floor	Computer lab	2			42	1	1	3	1	
24	1st floor	Class Room	6		4						
25	1st floor	Department Library	3		2	1	1				
26	1st floor	Staff Room	1		1						
27	1st floor	Staff Room	1		1	1	1				
28	1st floor	Class Room	6		4						
29	1st floor	Class Room	6		4						
30	1st floor	Lobby			11						
31	2nd floor	Exam cell	25		24						
32	2nd floor	Spot Valuation Room	6		11				3		
33	2nd floor	Dept Controller of Examination Room	4		3	1		1			
34	2nd floor	Processing Hall	6		12						
35	2nd floor	Exam cell	1		1						
36	2nd floor	Printing Room	2		3	3		1	1		
37	2nd floor	Exam cell	3		3	1		1	1		
38	2nd floor	Central Examination Co-ordinator	3		4						
39	2nd floor	Examination Cell	6		4	3					
40	2nd floor	Record Room	2		3						
41	2nd floor	Coding & Decoding section	3		2						
42	2nd Floor	Lobby	4		5		1				
43	2nd Floor	Exam Cell	6		8						

44	3rd floor	Exam Cell	9		12						
45	3rd floor	Exam Cell	12		8						
46	3rd floor	Sports Room	5		5						
47	3rd floor	Gym	8	1	4						
48	3rd floor	Lobby			8						
49	5th floor	Dept of Physics	19		13						
50	5th floor	Staff room	3		2	1	1	1	1		
51	5th floor	Staff room	2		1						
52	5th floor	Staff room	3		1						
53	5th floor	Staff room	2	7	1			1			
54	5th floor	Staff room	3		1						
55	5th floor	Staff room	3		1						
56	5th floor	Staff room	3		1	1	1				
57	5th floor	Staff room	3		1	1					
58	5th floor	Basic Science And Humanities	3		1	1	1				
59		HOD ROOM	3		2	1	1	1	1		
60		Staff Room	1		1	1	1				
61		Staff Room	1		1	1	1				
62		Staff Room	1		1	1	1	1			
63		Staff Room	5		2	1	1	1			
64		Chemistry Lab	2		3	1	1				
65		Staff Room	3		1						
66		Lobby			9						
		TOTAL	244	0	240	66	17	9	14	2	0

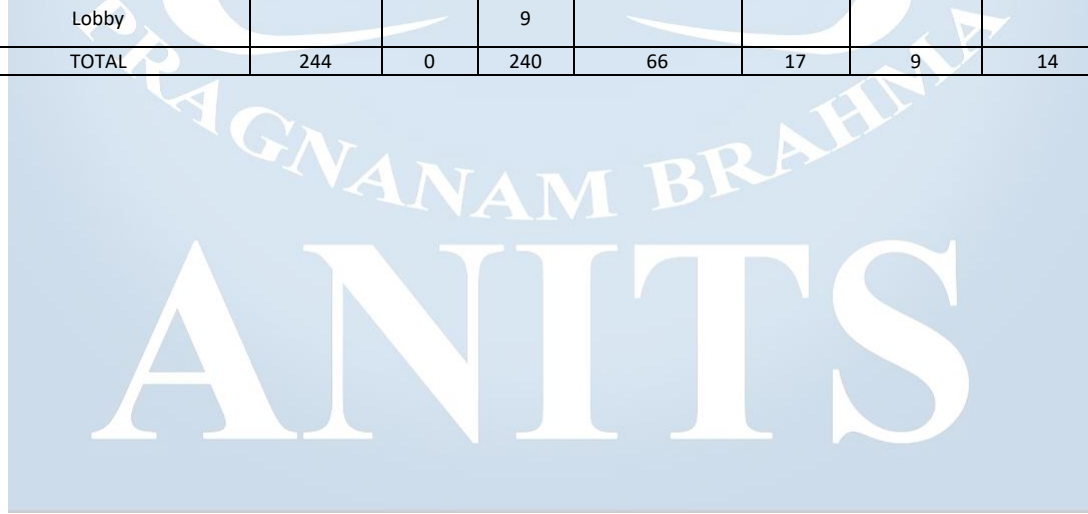

Annexure IV – Chemical Engineering.											
S No	Room	Utility	Ceiling fans	Pedestal fans	Tube lights	Desktops	UPS	Printers	AC's	LCD projectors	Wireless routers
1	D-102	Mechanical Operation Lab/Heat transfer Lab	7		7						
2	D-103	Staff Room	3		2						
3	D-104& 105	Chemical Technology Lab	12		10	1	1	1			
4	D-106	HOD	2		2	1	1		1		
5	107	Seminar Hall		12	7				3	1	
6	108	Seminar Hall	12		9	1			3	1	
7	Gf	Lobby			4						1
8	201	Faculty Room	2		2	1	1	1	1		
9	D-202	CR LAB	8		6						
10	D-2013	Dept Library	1		2	3	1	1	1		
11	D-204&203	Biotechnology Lab	11		10						
12	D-206	Staff Room	2		2						
13	D-211	Seminar Hall	11		4						
14	D-209	Faculty Room	3		2	1					
15	D-208	Comuter Lab	7		4	16					
16	1st Floor	Lobby			3						1
17	302	Class room	5		6						
18	303	Class room	5		6						
19	304	Class room	5		6					1	
20	305	Class room	5		6						
21	306	Faculty Room	3		2						
22	308		7		4						
23	312	Class room	7		4						
24	2nd floor	Lobby			4						1
25	402	Process Dynamicy Central Lab				1					
26	403	Class room	5		4						
27	404	Mass Transfer lab	12		10						
28	406	Faculty Room	2		2						
29	408	Class room	7		4						
30	412	Class room	7	4							
31		LOBBY			4						
32		TOTAL	151	16	138	25	4	3	9	3	3

Annexure V- EEE										
S No	Room	Ceiling fans	Pedestal fans	Tube lights	Desktops	UPS	Printers	AC's	LCD projectors	Wireless routers
1	101 -L	14		12						
2	102 -FR	2		2	2	2	1	1		
	105 -L	11		12						
	107 -L	10		9						
	108 -L	10		9	1					
	LOBBY		2	7					1	
	201-CR	5	1	4						
	202-CR	5		4						
	203-FR	3		2						
	204-WH	1	1	1						
	205-L	12		10						
	207-L	13		11						
	208-FR	2		2	1	1				
	209-LB	4	1	3	1	1				
	210-FR	4	1	1						
	LOBBY			2						1
	301-CR	5		4					1	
	302-CR									
	303	3		3						
	L	1		4	38	1		3		
	306-EH	5		2	1	1	1			
	307-CR	7		4						
	309-FR	3		2	1					
	310-FR	3		2						
	311-FR	3		2	1					
	312-FR	7		5					1	
	LOBBY			4						1
	313-SR			2						
	401-CR	8		4						
	402-CR	8		2						
	403-FR	2		2						
	404-FR	2		2						
	405-CR	8		4						
	406-CR	6		3						
	408-CR	7		5						
	409-CR	3		2						
	410-CR	3		2	1					
	412-CR	10		5						
	LOBBY			2						1
	TOTAL	190	0	158	47	6	2	4	3	3

Annexure VI - IT											
S No	Room	Utility	Ceiling fans	Pedestal fans	Tube lights	Desktops	UPS	Printers	AC's	LCD projectors	Wireless routers
1	301	WT LAB	1		8	28			1	1	
2	302	JAVA LAB	1		8	40	2	2	2		1
3	303	Project LAB	2		14	60	3	1	5	1	2
4	305	HOD	3		3	2	2	4	1		1
5	306	Faculty Cabin	2		1	1		1		1	
6	307	Class Room	6		6						
7	308	Staff Room	2		2	2					
8	309	Staff Room	2		2	2	1	1			
9	310	Class Room	6		6					1	
10	311	Class Room	6		5					1	
11	2nd floor	Lobby			3	4					
12	401	Class Room	6		5	1				1	
13	402	Class Room	6		5	1				1	
14	403	Faculty Cabin	2		2						
15	404		2		2	2		1			
16	406	Staff Room	6		4	3		2			1
17	407	De Lab									
18	408	Faculty Room	8		7	2	1	1			
19	409	Faculty Room	7		4	5	1	2			1
20	3rd floor	Lobby			3						
21	502& 503	IT Lab				130	2		11		
22	504	Faculty Cabin	4		2						
23	505	Faculty Cabin	2		2	1	1	1	1		
24	506	Faculty Cabin	4				1				
25	507	Class Room		6	4						
26	508	Staff Room	2		2						
27	509	Staff Room	2		2						
28	510	Class room	6		5						
29	511	Class room	6		5	1				1	
30		Lobby			8						

31		TOTAL	94	6	120	285	14	16	21	8	6
----	--	-------	----	---	-----	-----	----	----	----	---	---




Annexure VII - CIVIL

S No	Room	Utility	Ceiling fans	Pedestal fans	Tube lights	Desktops	UPS	Printers	AC's	LCD projectors	Wireless routers
1	GF	Geo Technical Engineers Lab	6		4						
2	107	Staff Room	2		2						
3	GF	Environment Engineering Lab	8		2						
4	GF	Concrete Technology Lab	11		8						
5	GF	Surveying Lab	1		2						
6	GF	Lobby			5						
7	1st Floor	Store Room			1						
8	1st Floor	M.Tech Class Room	3		2						
9	Gf	Geo Technical Eng Lab	6		6						
10	Gf	Faculty Room	2								
11	Gf	Environment Eng lab	8		2						
12	Gf	Concrete Technology Lab	11		8						
13	Gf	Surveying Lab	1		2						
14	Gf	Lobby			5						
15	1st floor	Store Room			1						
16	1st floor	M tech Class room	3		2						
17	1st floor	Staff Room	2		2	1	1				
18	1st floor	Seminar Hall				1	1		3	1	
19	1st floor	HOD office	3		5	2	2		1		
20		Staff Room	1		1						
21	1st floor	Tutorial Class Room	3		2						
22	1st floor	Staff Room	2		1						
23	1st floor	Computer lab	2			42	1	1	3	1	
24	1st floor	Class Room	6		4						
25	1st floor	Department Library	3		2	1	1				
26	1st floor	Staff Room	1		1						
27	1st floor	Staff Room	1		1	1	1				
28	1st floor	Class Room	6		4						
29	1st floor	Class Room	6		4						
30	1st floor	Lobby			11						
31	2nd floor	Exam cell	25		24						
32	2nd floor	Spot Valuation Room	6		11				3		
33	2nd floor	Dept Controller of Examination Room	4		3	1		1			
34	2nd floor	Processing Hall	6		12						
35	2nd floor	Exam cell	1		1						
36	2nd floor	Printing Room	2		3	3		1	1		
37	2nd floor	Exam cell	3		3	1		1	1		
38	2nd floor	Central Examination Co-ordinator	3		4						
39	2nd floor	Examination Cell	6		4	3					

40	2nd floor	Record Room	2		3						
41	2nd floor	Coding & Decoding section	3		2						
42	2nd Floor	Lobby	4		5		1				
43	3rd floor	Exam Cell	6		8						
44	3rd floor	Exam Cell	9		12						
45	3rd floor	Exam Cell	12		8						
46	3rd floor	Sports Room	5		5						
47	3rd floor	Gym	8	1	4						
48	3rd floor	Lobby			8						
49	5th floor	Dept of Physics	19		13						
50	5th floor	Staff room	3		2	1	1	1	1		
51	5th floor	Staff room	2		1						
52	5th floor	Staff room	3		1						
53	5th floor	Staff room	2	7	1			1			
54	5th floor	Staff room	3		1						
55	5th floor	Staff room	3		1						
56	5th floor	Staff room	3		1	1	1				
57	5th floor	Staff room	3		1	1					
58	5th floor	Basic Science And Humanities	3		1	1	1				
59		HOD ROOM	3		2	1	1	1	1		
60		Staff Room	1		1	1	1				
61		Staff Room	1		1	1	1				
62		Staff Room	1		1	1	1	1			
63		Staff Room	5		2	1	1	1			
64		Chemistry Lab	2		3	1	1				
65		Staff Room	3		1						
66		Lobby			9						
		TOTAL	244	0	240	66	17	9	14	2	0

Annexure VIII – Administration											
S No	Room	Utility	Ceiling fans	Pedestal fans	Tube lights	Desktops	UPS	Printers	AC's	LCD projectors	Wireless routers
1	Gf	Director Room	1		2	1		1	1		
2	Gf	Secretarial Room	2		7	1	1	2	1		
3	Gf	Conference Room							2	1	1
4	Gf	Principal Room	4		5	1		2	1		
5	Gf	Office Room	1			1					
6	Gf	Office Room	11		11	10		2			
7	Gf	Store Room	3		3						
8	A-108	HOD	1		2	1	1	1	1		
9	A-109	Faculty Room	8		7	2					
10	A-110	Class Room	5								
11	A-111	Class Room	8		5						
12	A-112	Class Room	8		5						
13	113	Class Room	6		6						
14	Gf	Lobby	7		11						
15	1st floor	201	1		23	66	3		5	1	
16	1st floor	202	15		9	1	2			2	
17	1st floor	203	1		3	1	1	1	1		1
18	1st floor	204	6		9	3	2	3			
19		Office Room	1		2	1	1	1			
20		Class room	32		20	4	1				1
21		Lobby			6						
22	2nd floor	Auditorium				1				1	1
23	2nd floor	302	1		2				1		
24	2nd floor	303	1		1				1		
25	2nd floor	304	1		1				1		
26	2nd floor	305	1		1				1		
27	2nd floor	308	2		3				1		
28	2nd floor	309			15				6		1
29	2nd floor	310	1		2	1			1		
30	2nd floor	311	40		34						1
	2nd floor	Lobby	2		5						
		TOTAL	170	0	200	95	12	13	24	5	6

Annexure IX						
S. no	Name of appliance	Power Rating(Watt)	Quantity	Power Consumption (Watt)	Average usage per day (hr)	Power Consumption/day (Watt)
A	B	C	D	E=C X D	F	G=E X F
1st floor						
1	Ceiling fans	80 W	13	0	12	0
2	Tube lights (LED) 4'feet	20W	6	120	6	720
3	Tube lights 4' feet	36 W	47	1692	6	10152
2nd Floor						
1	Ceiling fans	80 W	12	0	12	0
2	Tube lights (LED) 4'feet	20W	14	280	6	1680
3	Tube lights 4' feet	9 W	48	432	6	2592
3rd Floor						
1	Ceiling fans	36 W	12	0	12	0
2	Tube lights (LED) 4'feet	20 W	11	220	6	1320
3	Tube lights 4' feet	9 W	58	522	6	3132
4th Floor						
1	Ceiling fans	36 W	12	0	12	0
2	Tube lights (LED) 4'feet	20 W	5	100	6	600
3	Tube lights 4' feet	9 W	63	567	6	3402

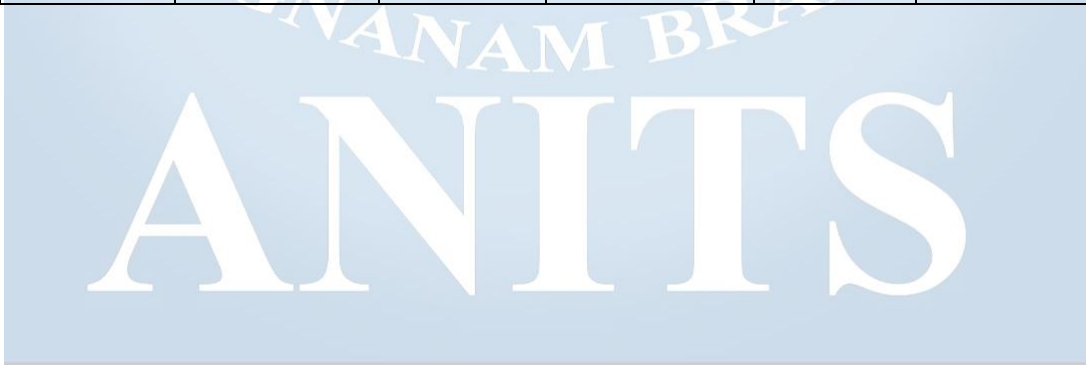

<i>Annexure X- Boys Hostel</i>						
S. no	Name of appliance	Power Rating(Watt)	Quantity	Power Consumption (Watt)	Average usage per day (hr)	Power Consumption/day (Watt)
A	B	C	D	E=C X D	F	G=E X F
A Block						
1	Ceiling fans	80 W	132	10560	12	126720
2	Tube lights (LED) 4'feet	20W	30	600	6	3600
3	Tube lights (LED) 1'feet	9 W	02	18	6	108
4	LED Bulbs	8W	12	96	6	576
5	Tube lights 4' feet	36 W	142	5112	6	30672
6	Tube lights 2' feet	20 W	08	160	6	960
7	Water cooler	2.8kwh/day	1	2800	day	2800
B Block						
1	Ceiling fans	80 W	212	16960	12	203520
2	Tube lights (LED) 4'feet	20W	32	640	6	3840
3	Tube lights (LED) 1'feet	9 W	96	864	6	5184
4	LED Bulbs	8W	81	648	6	3888
5	Tube lights 4' feet	36 W	216	7776	6	46656
6	Tube lights 2' feet	20 W	50	1000	6	6000
7	Water cooler	2.8kwh/day	1	2800	day	2800



Anil Neerukonda Institute of Technology and Sciences- Annexure IX
500 kVA Generator Fuel Consumption Report.

Month & Year	Usage of Gen Set in hours (tentatively)	Diesel Consumption per (lit/hour)	Total consumption (liters)
March 2019	11.08	35	387.8
April 2019	10.11	35	353.85
May 2019	24.05	35	841.75
June 2019	45.14	35	1579.9
July 2019	10.06	35	352.1
August 2019	15.09	35	528.15
September 2019	21.02	35	735.7
October 2019	19.11	35	668.85
November 2019	9.05	35	316.75
December 2019	6.22	35	217.7
January 2020	10.05	35	351.75
February 2020	11.08	35	387.8
March 2020	13.04	35	456.4
April 2020	10.12	35	354.2
Total			7532.7



Transport Fuel Consumption XI

#	Month	Total liters of fuel consumed by each of 21 buses	Average liters of fuel consumed by each of 21 buses
1	April 2019	3839	182.8
2	May 2019	3959	188.52
3	june	7746	368.85
4	july	10474	498.76
5	August	10232	487.23
6	September	10495	497.76
7	October	10302	490.57
8	November	11708	557.52
9	December	12505	595.47
10	Jan 2020	8409	400.42
11	Feb 2020	10465	498
12	March 2020	5387	256.52
	TOTAL	105521	



Sewage Treatment Plant -Annexure XII

S.no	Compartments	Company	Type/Frame No./Model No./mechine No..	Voltage	Current	Power	Horse Power	RPM	Number of pumps/Motars
1	Air Blower Motors	Crompton Greves	Freame No. 1832 M.J	415V	10.35 A	5.5	7.5	1450	2 motors
2	Sewge Transfer Pums	Crompton Greves	Mechine No. NDA 2 M.J	415V	2.42	1.1	1.5	2820	2
3	Sludge Feed Pumps	Crompton Greves	Mechine No. NDA 2 M.J	415V	2.42	1.1	1.5	2820	2
4	Filter Feed Pumps	Kirloskar	Mechine no. KDS - 225++	415V	3.9 A	1.5	1.5	2842	2
5	Booster Pumps	Grund Fos	CR 10-05-A-FJ-A-E-HQQE	415V	8.15/4.7A	2.2	3	2899	3
6	Everest Blower Motors	Everest Blopwer Motors	M5075	415V	NA	0.5kg/cm2	200m3	1300	2
7	Cutter Pumps	Aquatex	ASP 22P	415V	5.7 A	2.2	3	2900	4

PRAGNANAM BRAHMA
ANITS



E2e

Sewage treatment Plant

ANITS

@@@@@@@@@@

ENVIRO KAMKAR LLP



Team :

Dr. VINAY SAGAR

K.SRINIJA APARNA

SANCHARI BISWAS

Help us to assist you to develop green India.



